




Quality management systems
ISO 9001 – Cert. n° 0545/5



www.eurovent-certification.com
www.certiflash.com

NEW
MB control board
for **Modbus**
communication protocol
Compliant with ERP 2013 Regulation (EU) No. 327/2011

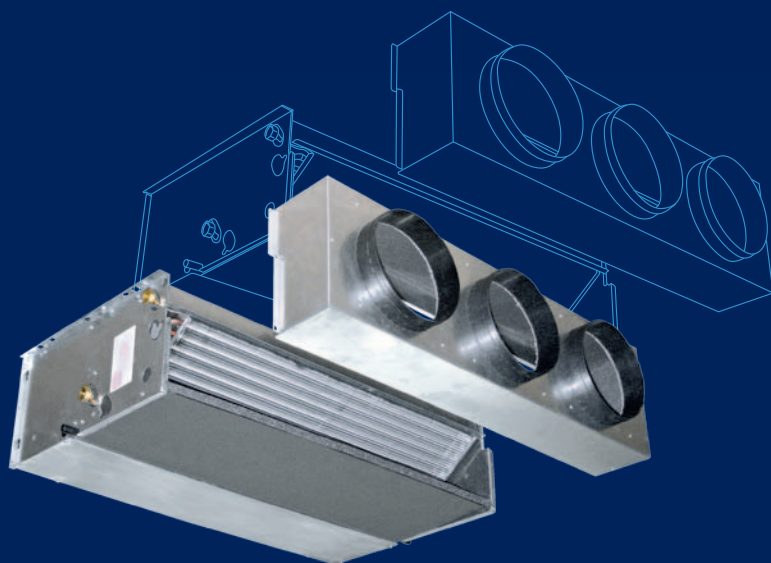

Air Conditioning
Carisma CRSO High Pressure Fan Coil Units



SABIANA
IL CLIMA AMICO

INTRODUCTION

In line with innovative trends and modern industrial design, the **Carisma CRSO** fan coil range meets today's demanding requirements of performance, size, acoustics, low energy, ease of installation and maintenance. The **Carisma CRSO** fan coil unit has been designed around a platform of models, versions and accessories, all of which have been independently tested and certified by Eurovent.

All **Carisma CRSO** fan coils with centrifugal fans are equipped with electric motors which reduce electrical consumption comparative to previous models, with 5 speed motors as standard offering greater flexibility in the selection of products.

New market trends have also led to an extension of the four pipe model which now has a two row LTHW battery giving improved outputs at lower flow and return temperatures.

A full range of control options is available including the Free patented wireless control offering greater flexibility in the installation of units, with the highest precision in monitoring and maintaining the desired comfort conditions.

The **Carisma CRSO** model is complemented with a full range of accessories: various types of adjustment valves, additional electric heater, auxiliary condensate pump, air inlet/outlet diffusers for fitted installations.

CONTENTS

• Presentation	Page 3
• Construction features	Page 3
• Dimension, Weight, Water content	Page 4
• EUROVENT Certification	Page 6
• Main performance and technical characteristics	Page 7
• Cooling emission tables	Page 8
• Heating emission tables	Page 12
• Correction factors table	Page 14
• Operation limits	Page 16
• Water pressure drop	Page 17
• Accessories	Page 18
• Wall electronic controls	Page 24
• FreeSabiana wireless control system	Page 30
• Controls and units MB version	Page 32
• Management system for a network of fan coils	Page 36
• PSM-DI and Sabianet electronic boards	Page 38




Sabiana take part to the Eurovent program of fan coil performance certification. The official figures are published in the web site www.eurovent-certification.com and in the web site www.certiflash.com. The tested performances are:

- | | |
|--|--|
| • Cooling total emission at the following conditions: <ul style="list-style-type: none">- Water temperature +7°C E.W.T. +12°C L.W.T.- Entering air temperature +27°C dry bulb +19°C wet bulb | • Cooling sensible emission at the following conditions: <ul style="list-style-type: none">- Water temperature +7°C E.W.T. +12°C L.W.T.- Entering air temperature +27°C dry bulb +19°C wet bulb |
| • Heating emission (2 pipe units) at the following conditions: <ul style="list-style-type: none">- Entering water temperature +50°C- Entering air temperature +20°C- Water flow rate as for the cooling conditions | • Heating emission (4 pipe units) at the following conditions: <ul style="list-style-type: none">- Water temperature +70°C E.W.T. +60°C L.W.T.- Entering air temperature +20°C |
| • Available pressure | • Fan absorption |
| | • Water pressure drop |
| | • Sound power |

Carisma CRSO version with centrifugal fan

Range includes 4 air flow rates (from 375 to 2220 m³/h), each equipped with 3 or 4 row coil and with the possibility to add a 1 or 2 row coil for 4 pipe systems.

It is the most comprehensive range, perfect to meet all air-conditioning requirements of work environments like offices, shops, restaurants and hotel rooms featuring ducted installations with available pressure up to 80 Pa.

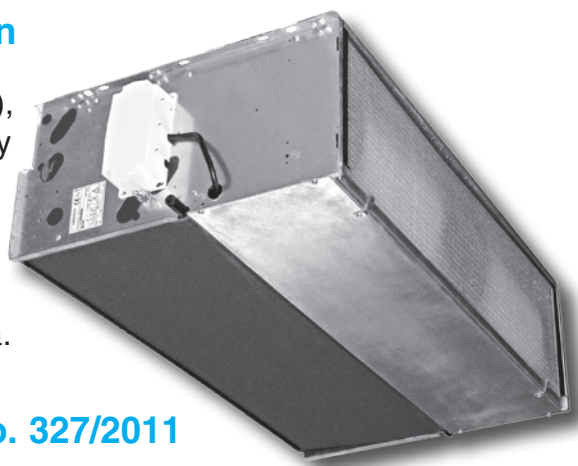

Compliant with ERP 2013 Regulation (EU) No. 327/2011

Construction features

Casing

Made from 1 mm galvanized steel insulated with polyolefin (PO) foam (class M1).

Filter

Polypropylene cellular fabric regenerating filter.

The filter frame of galvanized steel is inserted into special plastic sliding guides fastened to the internal structure for easy insertion and removal of the filter.

Fan assembly

The fans have aluminium or plastic blades directly keyed on the motor with double aspiration and they are dynamically and statically balanced during manufacture in order to have an extremely quiet operation.

Electric motor

The motor is wired for single phase and has five speeds with capacitor.

The motor is fitted on sealed for life bearings and is secured on anti-vibration and self-lubricating mountings. Internal thermal protection with automatic reset, protection IP 20, class B.

Coil

It is manufactured from drawn copper tube and the aluminium fins are mechanically bonded onto the tube by an expansion process. The coil has two 1/2 inch BSP internal connections and 1/8 inch BSP air vent and drain.

The coil is not suitable for use in corrosive atmosphere or in environments where aluminium may be subject to corrosion. The connections are on the left hand side looking from the air outlet of the unit (see picture).



On request or on site the connections can be moved to the other side.

Condensate collection tray

Made from plastic (ABS UL94 HB) with an "L"-shaped plastic fitted on the inner casing; the tray is insulated with polyolefin (PO) foam (class M1). The outside diameter of the condensate discharge pipe is 15mm.


Accessories and Controls

See pages 18 - 24.

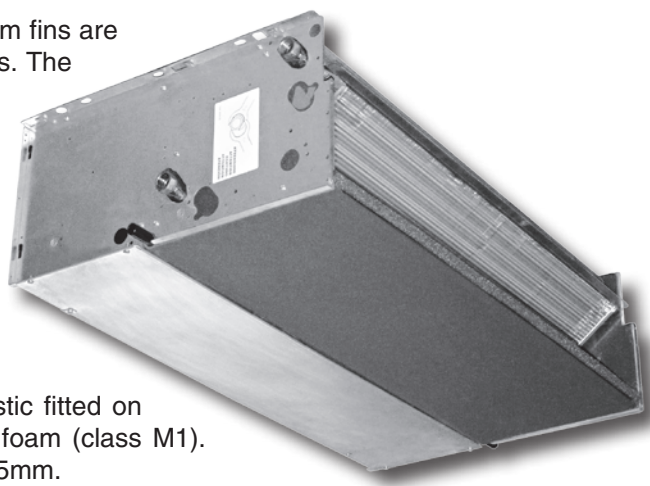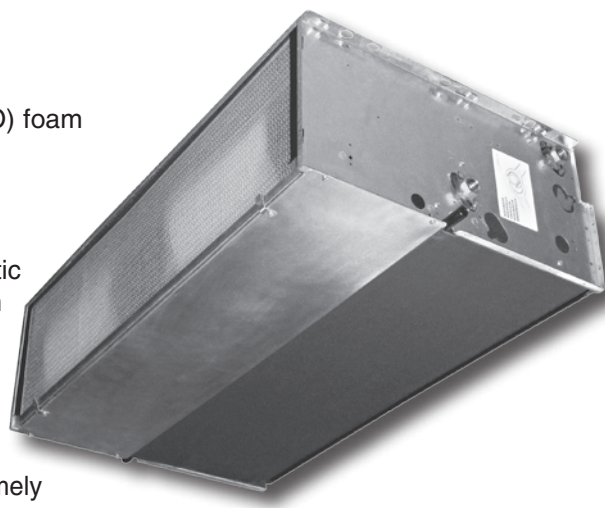


Dimensions, Weight, Water content

Vertical Installation

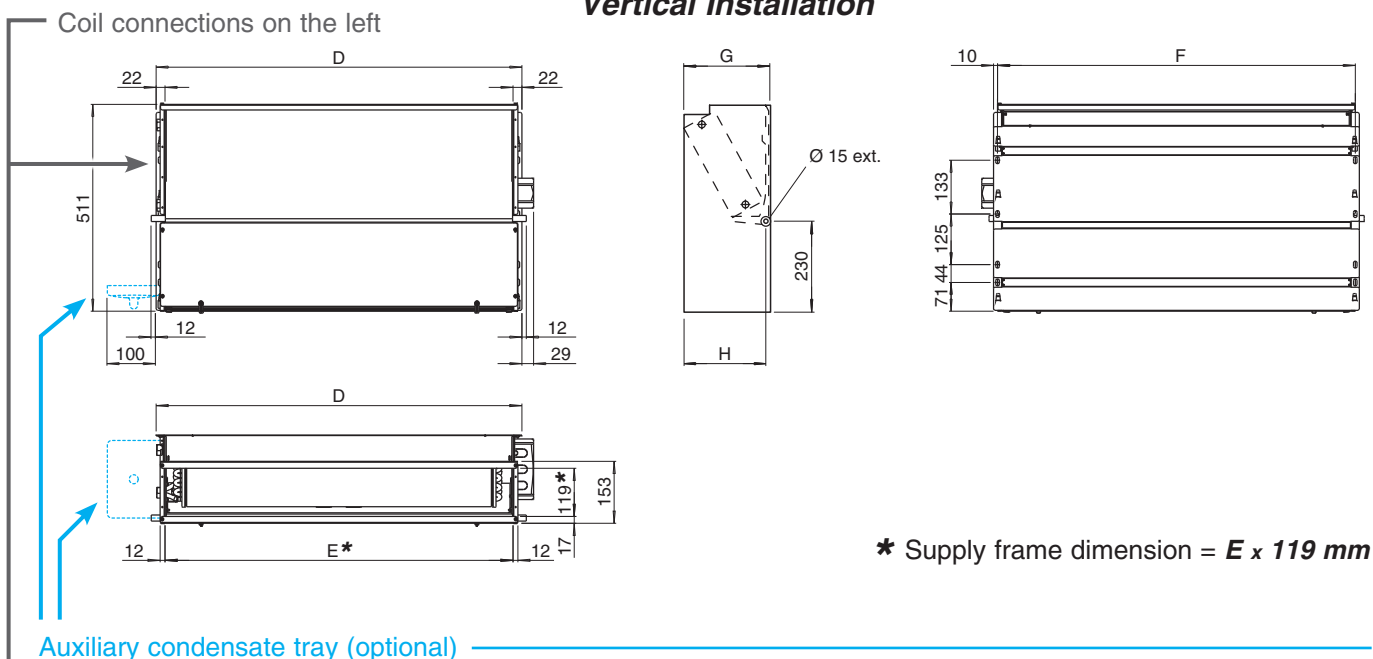


Horizontal Installation

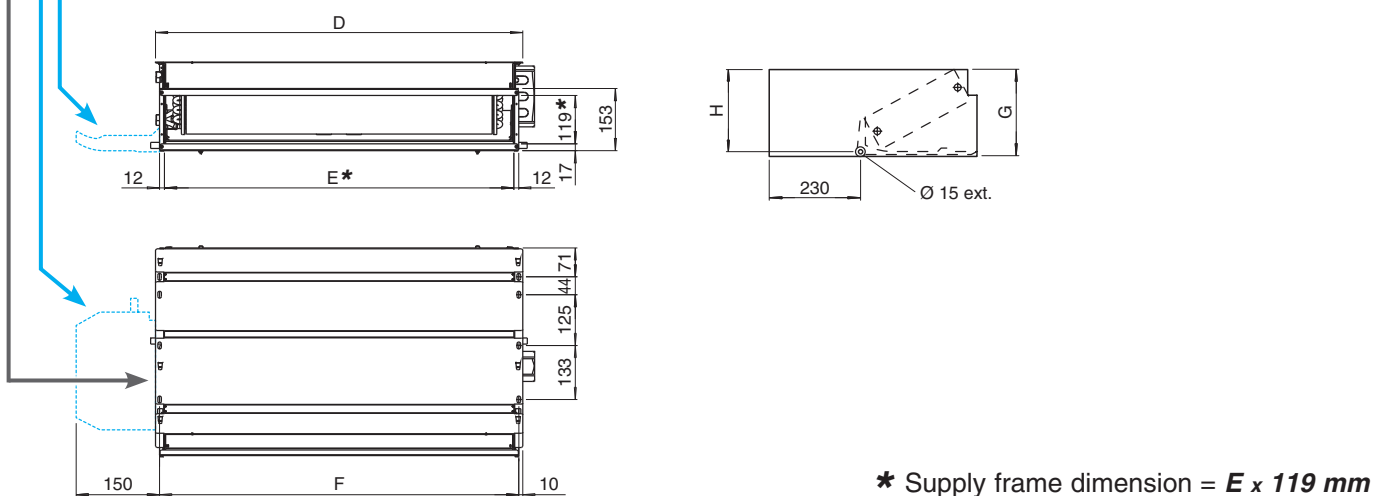


COIL CONNECTIONS

3 or 4 row coils

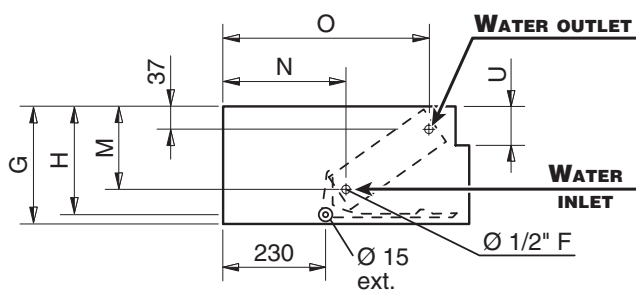


Heating additional coil (1 or 2 rows)

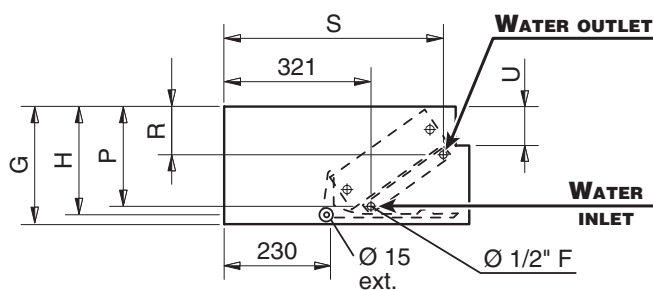

Dimension, Weight, Water content

PACKAGING

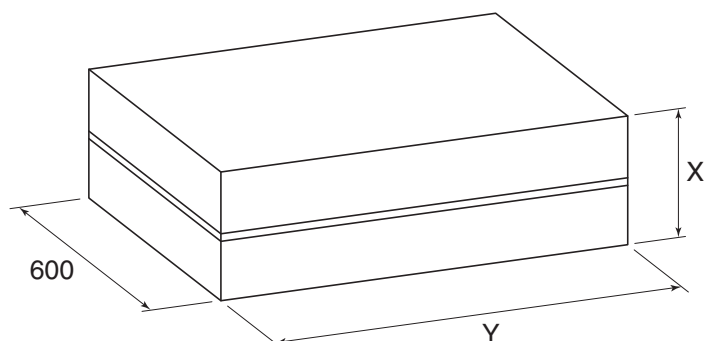

Dimension (mm)

MODEL	1	2	3	4
D	689	904	1119	1570
E	645	860	1075	1526
F	669	884	1099	1550
G	218	248	248	248
H	205	235	235	235
M	145	170	170	170
N	260	270	270	270
O	460	450	450	450
P	185	210	210	210
R	105	110	110	110
S	475	465	465	465
U	65	95	95	95
X	260	290	290	290
Y	820	1035	1250	1790

Weight (kg)

		Weight with packaging				Weight without packaging			
MODEL		1	2	3	4	1	2	3	4
Rows	3	19,1	26,1	30,4	47,7	17,3	23,5	27,3	43,3
	3+1	20,3	27,6	32,2	50,0	18,5	25,0	29,1	45,6
	3+2	21,0	28,5	33,3	–	19,2	25,9	30,2	–
	4	20,1	27,4	31,9	49,5	18,3	24,8	28,8	45,1
	4+1	21,3	28,9	33,7	51,8	19,5	26,3	30,6	47,4

Water content (litres)

MODEL	1	2	3	4
Rows	3	0,9	1,6	1,9
	4	1,3	2,2	2,8
	+1	0,3	0,5	0,9
	+2	0,6	1,0	1,2

EUROVENT Certification

www.eurovent-certification.com
www.certiflash.com

2 pipe units. The following standard rating conditions are used:

COOLING

Entering air temperature +27°C d.b. +19°C w.b.
 Water temperature +7°C E.W.T. +12°C L.W.T.

HEATING

Entering air temperature +20°C
 Entering water temperature +50°C
 Water flow rate as for the cooling conditions

MODEL		CRSO 13			CRSO 23			CRSO 33			CRSO 43		
		2	3	4	2	3	4	2	3	4	1	2	3
Speed (E)													
Air flow (E)	m³/h	240	285	310	470	525	580	760	885	960	945	1155	1285
Available pressure (E)	Pa	40	50	60	40	50	60	40	50	60	35	50	60
Cooling total emission (E)	kW	1,58	1,81	1,93	2,94	3,19	3,42	4,44	4,92	5,20	5,95	6,87	7,40
Cooling sensible emission (E)	kW	1,14	1,31	1,41	2,17	2,37	2,57	3,36	3,80	4,05	4,39	5,16	5,62
Heating (E)	kW	1,91	2,22	2,39	3,57	3,92	4,25	5,63	6,36	6,79	7,29	8,62	9,41
Dp Cooling (E)	kPa	9,0	11,5	12,9	10,6	12,3	13,9	11,4	13,7	15,1	8,9	11,5	13,1
Dp Heating (E)	kPa	6,9	9,0	10,3	8,3	9,8	11,4	9,0	11,0	11,9	6,8	9,2	10,8
Fan (E)	W	40	46	55	82	90	97	107	121	134	140	148	158
Sound power outlet (E)	dB(A)	44	47	50	46	49	51	51	54	57	52	56	58
Sound power inlet + radiated (E)	dB(A)	52	54	57	52	54	57	57	60	63	59	62	64
Sound pressure level outlet (*)	dB(A)	35	38	41	37	40	42	42	45	48	43	47	49
Sound pressure level inlet + radiated (*)	dB(A)	43	45	48	43	45	48	48	51	54	50	53	55
Plenum code (E)		9066363			9069222			9066368			9069224		

MODEL		CRSO 14			CRSO 24			CRSO 34			CRSO 44		
		2	3	4	2	3	4	2	3	4	1	2	3
Speed (E)													
Air flow (E)	m³/h	240	285	310	470	525	580	760	885	960	945	1155	1285
Available pressure (E)	Pa	40	50	60	40	50	60	40	50	60	35	50	60
Cooling total emission (E)	kW	1,74	2,01	2,15	3,27	3,57	3,85	4,80	5,36	5,68	6,51	7,59	8,22
Cooling sensible emission (E)	kW	1,23	1,43	1,54	2,32	2,55	2,77	3,52	3,99	4,25	4,68	5,54	6,05
Heating (E)	kW	2,06	2,41	2,60	3,90	4,30	4,69	6,00	6,83	7,31	7,85	9,39	10,30
Dp Cooling (E)	kPa	5,4	7,0	7,9	18,1	21,2	24,3	9,7	11,9	13,2	11,8	15,6	18,0
Dp Heating (E)	kPa	4,2	5,6	6,4	14,3	17,1	20,1	8,0	9,3	10,5	11,0	13,8	17,0
Fan (E)	W	40	46	55	82	90	97	107	121	134	140	148	158
Sound power outlet (E)	dB(A)	44	47	50	46	49	51	51	54	57	52	56	58
Sound power inlet + radiated (E)	dB(A)	52	54	57	52	54	57	57	60	63	59	62	64
Sound pressure level outlet (*)	dB(A)	35	38	41	37	40	42	42	45	48	43	47	49
Sound pressure level inlet + radiated (*)	dB(A)	43	45	48	43	45	48	48	51	54	50	53	55
Plenum code (E)		9066363			9069222			9066368			9069224		

4 pipe units. The following standard rating conditions are used:

COOLING

Entering air temperature +27°C d.b. +19°C w.b.
 Water temperature +7°C E.W.T. +12°C L.W.T.

HEATING

Entering air temperature +20°C
 Water temperature +70°C E.W.T. +60°C L.W.T.

MODEL		CRSO 13+1			CRSO 23+1			CRSO 33+1			CRSO 43+1		
		2	3	4	2	3	4	2	3	4	1	2	3
Speed (E)													
Air flow (E)	m³/h	240	285	310	470	525	580	760	885	960	945	1155	1285
Available pressure (E)	Pa	40	50	60	40	50	60	40	50	60	35	50	60
Cooling total emission (E)	kW	1,58	1,81	1,93	2,94	3,19	3,42	4,44	4,92	5,20	5,95	6,87	7,40
Cooling sensible emission (E)	kW	1,14	1,31	1,41	2,17	2,37	2,57	3,36	3,80	4,05	4,39	5,16	5,62
Heating (E)	kW	1,66	1,87	1,98	2,85	3,08	3,28	4,14	4,57	4,82	5,55	6,33	6,79
Dp Cooling (E)	kPa	9,0	11,5	12,9	11,2	13,0	14,7	11,4	13,7	15,1	8,9	11,5	13,1
Dp Heating (E)	kPa	5,3	6,6	7,3	3,8	4,3	4,8	6,2	7,4	8,1	13,5	17,2	19,5
Fan (E)	W	40	46	55	82	90	97	107	121	134	140	148	158
Sound power outlet (E)	dB(A)	44	47	50	46	49	51	51	54	57	52	56	58
Sound power inlet + radiated (E)	dB(A)	52	54	57	52	54	57	57	60	63	59	62	64
Sound pressure level outlet (*)	dB(A)	35	38	41	37	40	42	42	45	48	43	47	49
Sound pressure level inlet + radiated (*)	dB(A)	43	45	48	43	45	48	48	51	54	50	53	55
Plenum code (E)		9066363			9069222			9066368			9069224		

(E) = Eurovent certified performance.

(*) = The sound pressure levels are 9 dB(A) lower than the sound power levels and apply to the reverberant field of a 100 m³ room and a reverberation time of 0.5 sec..

Main performance and technical characteristics

2 pipe units. The following standard rating conditions are used:

COOLING

Entering air temperature +27°C d.b. +19°C w.b.
Water temperature + 7°C E.W.T. +12°C L.W.T.

HEATING

Entering air temperature +20°C
Entering water temperature +50°C
Water flow rate as for the cooling conditions

AVAILABLE PRESSURE: 0 Pa

MODEL		CRSO 13					CRSO 23					CRSO 33					CRSO 43				
Speed		1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5
Air flow	m³/h	375	410	470	540	595	580	665	765	870	1040	745	950	1150	1320	1415	1000	1360	1705	1980	2220
Cooling total emission	kW	2,22	2,36	2,59	2,84	3,02	3,42	3,75	4,12	4,48	5,01	4,38	5,16	5,85	6,38	6,68	6,21	7,69	8,94	9,84	10,59
Cooling sensible emission	kW	1,64	1,76	1,96	2,18	2,35	2,57	2,86	3,19	3,53	4,05	3,31	4,02	4,66	5,19	5,47	4,59	5,88	7,02	7,88	8,61
Heating	kW	3,62	3,91	4,37	4,89	5,28	5,50	6,15	6,89	7,63	8,76	7,19	8,78	10,23	11,40	12,04	9,90	12,78	15,35	17,31	18,91
Dp Cooling	kPa	16,6	18,5	21,8	25,7	28,7	13,9	16,4	19,4	22,6	27,7	11,1	14,9	18,7	21,9	23,8	9,6	14,1	18,5	22,0	25,1
Dp Heating	kPa	8,9	10,2	12,5	15,3	17,6	7,3	8,9	11,0	13,2	16,9	6,1	8,7	11,5	13,9	15,4	5,0	7,9	11,0	13,6	16,0
Fan	W	41	46	54	65	76	88	95	107	120	140	97	121	143	164	174	163	191	218	237	256
Sound power Lw	dB(A)	47	50	53	56	59	45	47	51	54	59	49	54	59	63	64	49	55	60	64	66
Sound pressure (*)	dB(A)	38	41	44	47	50	36	38	42	45	50	40	45	50	54	55	40	46	51	55	57

MODEL		CRSO 14					CRSO 24					CRSO 34					CRSO 44				
Speed		1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5
Air flow	m³/h	375	410	470	540	595	580	665	765	870	1040	745	950	1150	1320	1415	1000	1360	1705	1980	2220
Cooling total emission	kW	2,50	2,68	2,96	3,27	3,50	3,85	4,27	4,72	5,16	5,83	4,73	5,64	6,44	7,06	7,40	6,81	8,56	10,07	11,16	12,05
Cooling sensible emission	kW	1,82	1,96	2,19	2,46	2,66	2,77	3,10	3,47	3,84	4,43	3,47	4,22	4,91	5,47	5,78	4,91	6,34	7,63	8,59	9,41
Heating	kW	3,98	4,31	4,86	5,48	5,95	6,06	6,83	7,71	8,59	9,97	7,64	9,43	11,08	12,41	13,13	10,40	13,57	16,43	18,61	20,40
Dp Cooling	kPa	10,4	11,7	14,1	16,8	19,0	24,3	29,2	35,0	41,2	51,2	9,5	13,0	16,5	19,5	21,2	12,9	19,4	26,0	31,2	35,9
Dp Heating	kPa	5,4	6,2	7,7	9,5	11,1	12,3	15,2	19,0	23,0	30,1	5,0	7,3	9,8	12,0	13,3	7,0	11,4	16,1	20,1	23,7
Fan	W	41	46	54	65	76	88	95	107	120	140	97	121	143	164	174	163	191	218	237	256
Sound power Lw	dB(A)	47	50	53	56	59	45	47	51	54	59	49	54	59	63	64	49	55	60	64	66
Sound pressure (*)	dB(A)	38	41	44	47	50	36	38	42	45	50	40	45	50	54	55	40	46	51	55	57

4 pipe units. The following standard rating conditions are used:

COOLING

Entering air temperature +27°C d.b. +19°C w.b.
Water temperature + 7°C E.W.T. +12°C L.W.T.

HEATING

Entering air temperature +20°C
Water temperature +70°C E.W.T. +60°C L.W.T.

AVAILABLE PRESSURE: 0 Pa

MODEL		CRSO 13+1					CRSO 23+1					CRSO 33+1					CRSO 43+1				
Speed		1	2	3	4	5	1	2	3	4	5	1	2	3	4	5	1	2	3	4	5
Air flow	m³/h	375	410	470	540	595	580	665	765	870	1040	745	950	1150	1320	1415	1000	1360	1705	1980	2220
Cooling total emission	kW	2,22	2,36	2,59	2,84	3,02	3,42	3,75	4,12	4,48	5,01	4,38	5,16	5,85	6,38	6,68	6,21	7,69	8,94	9,84	10,59
Cooling sensible emission	kW	1,64	1,76	1,96	2,18	2,35	2,57	2,86	3,19	3,53	4,05	3,31	4,02	4,66	5,19	5,47	4,59	5,88	7,02	7,88	8,61
Heating	kW	2,25	2,39	2,61	2,85	3,04	3,28	3,58	3,92	4,25	4,76	4,08	4,79	5,40	5,89	6,16	5,76	7,04	8,14	8,95	9,63
Dp Cooling	kPa	16,6	18,5	21,8	25,7	28,7	13,9	16,4	19,4	22,6	27,7	11,1	14,9	18,7	21,9	23,8	9,6	14,1	18,5	22,0	25,1
Dp Heating	kPa	9,2	10,3	12,0	14,1	15,8	4,8	5,7	6,7	7,7	9,4	6,0	8,0	10,0	11,7	12,7	14,5	20,8	27,0	32,0	36,6
Fan	W	41	46	54	65	76	88	95	107	120	140	97	121	143	164	174	163	191	218	237	256
Sound power Lw	dB(A)	47	50	53	56	59	45	47	51	54	59	49	54	59	63	64	49	55	60	64	66
Sound pressure (*)	dB(A)	38	41	44	47	50	36	38	42	45	50	40	45	50	54	55	40	46	51	55	57

(*) = The sound pressure levels are 9 dB(A) lower than the sound power levels and apply to the reverberant field of a 100 m³ room and a reverberation time of 0.5 sec..

Cooling emission of 3 row coil

Entering air temperature: 27°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 13	5		595	3,25	2,32	559	32,8	2,92	2,19	502	26,9	2,26	2,01	389	16,8	1,70	1,70	292	10,0
	4	MAX	540	3,05	2,16	525	29,3	2,74	2,04	472	24,1	2,12	1,86	365	15,0	1,59	1,59	273	8,8
	3	MED	470	2,78	1,95	479	24,9	2,51	1,83	431	20,5	1,93	1,67	333	12,7	1,44	1,44	247	7,4
	2	MIN	410	2,54	1,75	437	21,0	2,29	1,65	393	17,3	1,76	1,49	303	10,7	1,30	1,30	224	6,2
	1		375	2,38	1,64	410	18,8	2,15	1,54	370	15,5	1,65	1,38	284	9,6	1,22	1,22	210	5,5
CRSO 23	5		1040	5,42	3,96	931	31,8	4,84	3,78	833	25,9	3,77	3,48	649	16,4	2,85	2,85	489	9,8
	4	MAX	870	4,84	3,47	832	26,0	4,33	3,30	745	21,2	3,36	3,02	577	13,3	2,51	2,51	432	7,8
	3	MED	765	4,45	3,15	765	22,3	3,98	2,99	685	18,2	3,08	2,71	530	11,4	2,29	2,29	395	6,6
	2	MIN	665	4,05	2,83	696	18,8	3,63	2,68	624	15,4	2,80	2,42	481	9,6	2,07	2,07	357	5,5
	1		580	3,68	2,55	633	15,9	3,31	2,40	569	13,0	2,54	2,16	438	8,1	1,88	1,88	323	4,6
CRSO 33	5		1415	7,21	5,32	1240	27,3	6,44	5,11	1108	22,2	5,02	4,72	863	14,0	3,79	3,79	651	8,4
	4	MAX	1320	6,91	5,06	1188	25,3	6,17	4,85	1061	20,5	4,80	4,46	825	12,9	3,61	3,61	621	7,7
	3	MED	1150	6,33	4,57	1089	21,6	5,66	4,36	973	17,5	4,38	3,98	754	11,0	3,28	3,28	564	6,5
	2	MIN	950	5,59	3,96	961	17,2	4,99	3,76	859	14,0	3,85	3,40	663	8,7	2,86	2,86	492	5,1
	1		745	4,73	3,28	814	12,8	4,23	3,10	728	10,4	3,26	2,78	560	6,4	2,40	2,40	413	3,7
CRSO 43	5		2220	11,43	8,40	1966	28,8	10,21	8,03	1756	23,4	7,95	7,41	1368	14,8	6,00	6,00	1032	8,8
	4		1980	10,63	7,72	1829	25,3	9,51	7,36	1636	20,6	7,38	6,76	1270	12,9	5,54	5,54	953	7,6
	3	MAX	1705	9,66	6,91	1662	21,3	8,64	6,56	1487	17,3	6,68	5,98	1149	10,8	4,99	4,99	858	6,3
	2	MED	1360	8,31	5,82	1430	16,2	7,45	5,50	1281	13,3	5,73	4,96	985	8,2	4,24	4,24	729	4,7
	1	MIN	1000	6,69	4,57	1151	11,0	6,01	4,30	1034	9,0	4,61	3,83	792	5,5	3,38	3,38	581	3,1

Cooling emission of 3 row coil

Entering air temperature: 26°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 13	5		595	2,90	2,20	499	26,8	2,57	2,10	442	21,4	1,97	1,93	339	13,1	1,46	1,46	251	7,6
	4	MAX	540	2,73	2,04	469	24,0	2,41	1,95	415	19,1	1,84	1,78	317	11,7	1,36	1,36	234	6,7
	3	MED	470	2,49	1,83	428	20,3	2,20	1,75	379	16,2	1,67	1,58	288	9,8	1,23	1,23	211	5,6
	2	MIN	410	2,27	1,65	391	17,3	2,01	1,57	346	13,8	1,52	1,41	262	8,3	1,11	1,11	191	4,6
	1		375	2,14	1,54	368	15,4	1,89	1,46	325	12,3	1,43	1,31	246	7,4	1,04	1,04	178	4,1
CRSO 23	5		1040	4,82	3,78	829	25,8	4,28	3,63	736	20,7	3,29	3,29	566	12,8	2,45	2,45	422	7,5
	4	MAX	870	4,31	3,30	741	21,1	3,82	3,15	657	16,9	2,92	2,88	502	10,3	2,16	2,16	371	5,9
	3	MED	765	3,96	2,99	682	18,1	3,51	2,85	603	14,5	2,67	2,58	460	8,8	1,96	1,96	338	5,0
	2	MIN	665	3,61	2,68	622	15,4	3,19	2,54	549	12,2	2,42	2,30	417	7,4	1,77	1,77	304	4,2
	1		580	3,29	2,41	566	13,0	2,91	2,28	500	10,3	2,20	2,04	378	6,2	1,60	1,60	275	3,4
CRSO 33	5		1415	6,41	5,11	1102	22,1	5,69	4,90	979	17,7	4,38	4,38	754	11,0	3,27	3,27	562	6,4
	4	MAX	1320	6,14	4,84	1056	20,4	5,44	4,64	936	16,4	4,18	4,18	719	10,1	3,11	3,11	535	5,9
	3	MED	1150	5,63	4,36	968	17,5	4,98	4,16	856	13,9	3,81	3,80	655	8,5	2,81	2,81	484	4,9
	2	MIN	950	4,97	3,76	854	13,9	4,39	3,57	755	11,1	3,34	3,24	574	6,7	2,45	2,45	421	3,8
	1		745	4,22	3,11	725	10,4	3,72	2,94	640	8,3	2,81	2,63	483	4,9	2,04	2,04	351	2,7
CRSO 43	5		2220	10,17	8,04	1749	23,3	9,02	7,70	1551	18,7	6,94	6,94	1193	11,6	5,17	5,17	889	6,7
	4		1980	9,46	7,37	1628	20,5	8,38	7,04	1442	16,4	6,42	6,42	1105	10,1	4,76	4,76	819	5,8
	3	MAX	1705	8,60	6,57	1479	17,3	7,61	6,26	1309	13,8	5,80	5,69	998	8,4	4,27	4,27	735	4,8
	2	MED	1360	7,40	5,51	1273	13,2	6,54	5,22	1124	10,5	4,96	4,71	852	6,3	3,61	3,61	621	3,5
	1	MIN	1000	5,98	4,31	1028	9,0	5,27	4,07	907	7,1	3,97	3,62	683	4,2	2,86	2,86	492	2,3

Correction factors for different R.H.

R.H.	WT:	7/12°C	8/13°C	10/15°C	12/17°C
48%	Pc	0,95	0,94	1,00	1,00
	Ps	1,00	1,00	1,00	1,00
46%	Pc	0,90	0,88	1,00	1,00
	Ps	1,00	1,00	1,00	1,00

LEGEND

WT = Water temperature

Pc = Cooling total emission

Ps = Cooling sensible emission

Qw = Water flow

Dp(c) = Water pressure drop

Speed = Fan speed

MAX = High speed

MED = Medium speed

MIN = Low speed

Qv = Air flow

Cooling emission of 3 row coil

Entering air temperature: 25°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 13	5		595	2,56	2,10	441	21,4	2,26	2,01	388	16,9	1,71	1,71	294	10,2	1,24	1,24	214	5,7
	4	MAX	540	2,41	1,95	414	19,1	2,12	1,86	364	15,1	1,60	1,60	274	9,0	1,16	1,16	199	5,0
	3	MED	470	2,19	1,75	378	16,2	1,93	1,66	331	12,8	1,45	1,45	249	7,5	1,04	1,04	179	4,1
	2	MIN	410	2,00	1,57	344	13,7	1,76	1,49	302	10,8	1,31	1,31	225	6,3	0,94	0,94	161	3,4
	1		375	1,88	1,46	324	12,3	1,65	1,38	284	9,6	1,23	1,23	211	5,6	0,87	0,87	150	3,0
CRSO 23	5		1040	4,27	3,62	734	20,7	3,76	3,47	647	16,5	2,86	2,86	492	10,0	2,24	2,24	385	6,3
	4	MAX	870	3,81	3,15	655	16,9	3,35	3,00	576	13,3	2,53	2,53	435	8,0	1,88	1,88	324	4,6
	3	MED	765	3,49	2,85	601	14,5	3,07	2,71	528	11,4	2,31	2,31	397	6,8	1,67	1,67	287	3,7
	2	MIN	665	3,18	2,55	547	12,2	2,79	2,41	480	9,6	2,09	2,09	359	5,7	1,50	1,50	257	3,1
	1		580	2,90	2,28	498	10,3	2,54	2,16	436	8,1	1,89	1,89	325	4,7	1,35	1,35	231	2,5
CRSO 33	5		1415	5,68	4,90	976	17,7	5,01	4,69	861	14,1	3,81	3,81	656	8,5	3,17	3,17	545	6,1
	4	MAX	1320	5,43	4,63	934	16,4	4,78	4,44	823	13,0	3,63	3,63	625	7,8	2,96	2,96	510	5,4
	3	MED	1150	4,96	4,16	853	13,9	4,37	3,97	752	11,0	3,30	3,30	567	6,6	2,59	2,59	446	4,2
	2	MIN	950	4,38	3,58	753	11,1	3,84	3,40	661	8,8	2,88	2,88	496	5,2	2,16	2,16	371	3,0
	1		745	3,71	2,94	638	8,2	3,24	2,78	558	6,4	2,42	2,42	416	3,8	1,72	1,72	296	2,0
CRSO 43	5		2220	9,00	7,70	1548	18,7	7,93	7,38	1365	14,9	6,03	6,03	1038	9,0	4,88	4,88	840	6,1
	4		1980	8,36	7,04	1437	16,4	7,36	6,73	1266	13,0	5,57	5,57	959	7,8	4,37	4,37	752	5,0
	3	MAX	1705	7,58	6,26	1304	13,8	6,67	5,96	1147	10,9	5,02	5,02	864	6,5	3,78	3,78	650	3,8
	2	MED	1360	6,51	5,23	1120	10,5	5,71	4,95	983	8,2	4,27	4,27	734	4,8	3,05	3,05	525	2,6
	1	MIN	1000	5,25	4,07	904	7,1	4,60	3,84	790	5,6	3,40	3,40	585	3,2	2,40	2,40	412	1,7

Correction factors for different R.H.

R.H.	WT:	7/12°C	8/13°C	10/15°C	12/17°C
48%	Pc	0,95	0,94	1,00	1,00
	Ps	1,00	1,00	1,00	1,00
46%	Pc	0,90	0,88	1,00	1,00
	Ps	1,00	1,00	1,00	1,00

LEGEND

WT = Water temperature

Pc = Cooling total emission

Ps = Cooling sensible emission

Qw = Water flow

Dp(c) = Water pressure drop

Speed = Fan speed

MAX = High speed

MED = Medium speed

MIN = Low speed

Qv = Air flow

Cooling emission of 4 row coil

Entering air temperature: 27°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 14	5		595	3,78	2,63	651	21,9	3,39	2,49	583	17,8	2,61	2,23	448	11,0	1,92	1,92	331	6,3
	4	MAX	540	3,53	2,44	607	19,3	3,17	2,30	544	15,8	2,43	2,05	418	9,7	1,79	1,79	308	5,6
	3	MED	470	3,19	2,18	549	16,1	2,87	2,05	493	13,2	2,20	1,83	378	8,1	1,61	1,61	277	4,6
	2	MIN	410	2,88	1,95	496	13,4	2,60	1,84	446	11,0	1,99	1,62	342	6,8	1,45	1,44	250	3,8
	1		375	2,69	1,81	463	11,8	2,43	1,70	418	9,8	1,86	1,50	320	6,0	1,35	1,33	233	3,4
CRSO 24	5		1040	6,27	4,39	1078	58,3	5,64	4,14	970	48,0	4,37	3,75	751	30,0	3,25	3,25	559	17,5
	4	MAX	870	5,54	3,82	953	46,7	5,00	3,60	861	38,7	3,86	3,24	664	24,0	2,85	2,85	491	13,8
	3	MED	765	5,06	3,45	870	39,7	4,57	3,25	787	32,9	3,52	2,90	606	20,4	2,59	2,59	446	11,6
	2	MIN	665	4,57	3,09	786	33,0	4,13	2,91	711	27,4	3,18	2,58	548	17,0	2,33	2,30	402	9,6
	1		580	4,12	2,77	709	27,4	3,73	2,60	642	22,8	2,88	2,30	495	14,2	2,10	2,04	362	8,0
CRSO 34	5		1415	8,00	5,69	1376	24,4	7,15	5,40	1230	19,8	5,51	4,92	948	12,3	4,11	4,11	707	7,2
	4	MAX	1320	7,64	5,40	1314	22,4	6,83	5,12	1174	18,3	5,26	4,65	905	11,3	3,91	3,91	673	6,6
	3	MED	1150	6,96	4,86	1197	19,0	6,22	4,59	1070	15,4	4,78	4,15	822	9,5	3,54	3,54	609	5,5
	2	MIN	950	6,09	4,19	1047	14,9	5,46	3,95	938	12,2	4,19	3,54	720	7,5	3,07	3,07	529	4,3
	1		745	5,10	3,45	876	10,8	4,58	3,24	789	8,9	3,50	2,88	603	5,4	2,56	2,56	440	3,1
CRSO 44	5		2220	13,06	9,27	2246	41,4	11,67	8,80	2007	33,7	9,01	7,97	1549	20,9	6,70	6,70	1152	12,2
	4		1980	12,08	8,49	2078	36,0	10,80	8,04	1858	29,3	8,32	7,25	1431	18,1	6,17	6,17	1061	10,5
	3	MAX	1705	10,89	7,56	1873	29,9	9,75	7,14	1677	24,4	7,49	6,40	1289	15,0	5,53	5,53	950	8,6
	2	MED	1360	9,25	6,32	1592	22,3	8,30	5,94	1428	18,2	6,37	5,28	1095	11,2	4,66	4,66	801	6,3
	1	MIN	1000	7,32	4,90	1259	14,6	6,60	4,60	1136	12,1	5,05	4,05	869	7,4	3,67	3,57	631	4,1

Cooling emission of 4 row coil

Entering air temperature: 26°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 14	5		595	3,37	2,49	580	17,8	2,98	2,36	512	14,2	2,25	2,11	388	8,5	1,64	1,64	281	4,7
	4	MAX	540	3,15	2,30	541	15,7	2,78	2,18	479	12,5	2,10	1,94	361	7,5	1,52	1,52	261	4,1
	3	MED	470	2,85	2,06	490	13,1	2,52	1,94	433	10,5	1,90	1,72	326	6,2	1,36	1,36	235	3,4
	2	MIN	410	2,58	1,84	444	11,0	2,28	1,73	392	8,7	1,71	1,53	294	5,2	1,23	1,23	211	2,8
	1		375	2,41	1,71	415	9,7	2,13	1,61	367	7,7	1,60	1,41	275	4,6	1,14	1,14	196	2,5
CRSO 24	5		1040	5,62	4,15	966	47,9	4,97	3,94	856	38,3	3,79	3,57	652	23,3	2,78	2,78	478	13,2
	4	MAX	870	4,98	3,61	856	38,5	4,40	3,41	757	30,7	3,34	3,07	575	18,5	2,43	2,43	418	10,4
	3	MED	765	4,54	3,26	781	32,7	4,02	3,08	692	26,1	3,04	2,75	523	15,7	2,20	2,20	379	8,7
	2	MIN	665	4,10	2,91	706	27,2	3,64	2,74	626	21,8	2,74	2,44	472	13,0	1,97	1,97	340	7,1
	1		580	3,71	2,61	637	22,6	3,29	2,45	566	18,2	2,48	2,17	426	10,8	1,77	1,77	305	5,9
CRSO 34	5		1415	7,12	5,41	1224	19,8	6,29	5,15	1081	15,7	4,79	4,70	824	9,5	3,52	3,52	606	5,4
	4	MAX	1320	6,80	5,13	1169	18,2	6,00	4,88	1032	14,5	4,56	4,43	785	8,8	3,35	3,35	576	5,0
	3	MED	1150	6,19	4,60	1065	15,4	5,46	4,37	940	12,2	4,14	3,94	712	7,4	3,02	3,02	520	4,1
	2	MIN	950	5,43	3,96	934	12,1	4,79	3,74	824	9,6	3,61	3,35	621	5,7	2,61	2,61	449	3,2
	1		745	4,56	3,25	784	8,9	4,02	3,06	691	7,0	3,02	2,72	519	4,2	2,16	2,16	372	2,3
CRSO 44	5		2220	11,61	8,81	1996	33,5	10,27	8,38	1767	26,8	7,81	7,58	1343	16,2	5,73	5,73	986	9,2
	4		1980	10,74	8,05	1848	29,1	9,50	7,64	1635	23,3	7,21	6,88	1240	14,0	5,26	5,26	905	7,9
	3	MAX	1705	9,70	7,15	1668	24,2	8,57	6,76	1473	19,3	6,48	6,06	1114	11,6	4,70	4,70	808	6,4
	2	MED	1360	8,26	5,96	1420	18,1	7,29	5,61	1253	14,4	5,48	4,98	943	8,6	3,94	3,94	678	4,7
	1	MIN	1000	6,56	4,62	1128	12,0	5,79	4,33	996	9,5	4,34	3,81	746	5,6	3,09	3,09	531	3,0

Correction factors for different R.H.

R.H.	WT:	7/12°C	8/13°C	10/15°C	12/17°C
48%	Pc	0,95	0,94	1,00	1,00
	Ps	1,00	1,00	1,00	1,00
46%	Pc	0,90	0,88	1,00	1,00
	Ps	1,00	1,00	1,00	1,00

LEGEND

WT = Water temperature

Pc = Cooling total emission

Ps = Cooling sensible emission

Qw = Water flow

Dp(c) = Water pressure drop

Speed = Fan speed

MAX = High speed

MED = Medium speed

MIN = Low speed

Qv = Air flow

Cooling emission of 4 row coil

Entering air temperature: 25°C – R. H.: 50% – Available pressure: 0 Pa

			WT: 7/12 °C					WT: 8/13 °C				WT: 10/15 °C				WT: 12/17 °C			
Mod.	Speed		Qv	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)	Pc	Ps	Qw	Dp(c)
			m³/h	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa	kW	kW	l/h	kPa
CRSO 14	5		595	2,97	2,36	510	14,1	2,60	2,23	447	11,1	1,94	1,94	333	6,5	1,38	1,38	237	3,5
	4	MAX	540	2,77	2,18	477	12,5	2,43	2,06	418	9,8	1,80	1,80	310	5,7	1,28	1,28	220	3,0
	3	MED	470	2,51	1,94	432	10,4	2,19	1,83	377	8,2	1,62	1,62	279	4,7	1,14	1,14	196	2,5
	2	MIN	410	2,27	1,73	390	8,7	1,98	1,63	341	6,8	1,46	1,44	252	3,9	1,02	1,02	176	2,0
	1		375	2,12	1,61	365	7,7	1,85	1,51	319	6,0	1,36	1,33	235	3,4	0,95	0,95	163	1,8
CRSO 24	5		1040	4,96	3,94	853	38,2	4,36	3,75	749	30,1	3,27	3,27	563	17,9	2,35	2,35	405	9,8
	4	MAX	870	4,39	3,42	754	30,7	3,85	3,24	662	24,1	2,87	2,87	494	14,1	2,05	2,05	352	7,6
	3	MED	765	4,01	3,08	690	26,1	3,51	2,91	604	20,5	2,61	2,60	450	11,9	1,85	1,85	318	6,3
	2	MIN	665	3,62	2,75	623	21,8	3,17	2,59	546	17,1	2,35	2,30	405	9,9	1,65	1,65	284	5,2
	1		580	3,28	2,45	563	18,1	2,87	2,31	493	14,2	2,12	2,04	364	8,2	1,48	1,48	254	4,2
CRSO 34	5		1415	6,27	5,16	1078	55,7	5,50	4,91	946	42,4	4,14	4,14	713	34,4	3,15	3,15	541	14,4
	4	MAX	1320	5,98	4,88	1028	52,4	5,25	4,64	903	41,4	3,94	3,94	678	32,7	2,94	2,94	506	13,9
	3	MED	1150	5,45	4,37	937	47,2	4,77	4,15	821	37,6	3,57	3,57	613	29,6	2,58	2,58	444	12,3
	2	MIN	950	4,77	3,75	820	39,6	4,17	3,54	717	32,5	3,10	3,10	533	24,4	2,20	2,20	378	10,3
	1		745	4,00	3,07	688	34,0	3,49	2,89	601	27,5	2,58	2,56	443	20,1	1,81	1,81	311	8,6
CRSO 44	5		2220	10,23	8,37	1759	100,0	8,99	7,96	1546	74,0	6,75	6,75	1161	54,4	5,07	5,07	872	24,4
	4		1980	9,47	7,64	1629	92,2	8,30	7,24	1428	67,3	6,21	6,21	1068	50,7	4,54	4,54	781	22,0
	3	MAX	1705	8,53	6,77	1467	84,0	7,48	6,40	1286	60,1	5,57	5,57	957	44,8	3,95	3,95	680	19,7
	2	MED	1360	7,26	5,62	1248	68,4	6,35	5,29	1092	51,3	4,70	4,69	808	38,5	3,30	3,30	568	16,4
	1	MIN	1000	5,77	4,34	992	50,0	5,04	4,07	866	40,4	3,70	3,57	636	30,2	2,56	2,56	440	12,2

Correction factors for different R.H.

R.H.	WT:	7/12°C	8/13°C	10/15°C	12/17°C
48%	Pc	0,95	0,94	1,00	1,00
	Ps	1,00	1,00	1,00	1,00
46%	Pc	0,90	0,88	1,00	1,00
	Ps	1,00	1,00	1,00	1,00

LEGEND

WT = Water temperature

Pc = Cooling total emission

Ps = Cooling sensible emission

Qw = Water flow

Dp(c) = Water pressure drop

Speed = Fan speed

MAX = High speed

MED = Medium speed

MIN = Low speed

Qv = Air flow

Heating emission of 3 row coil

Entering air temperature: 20°C – Available pressure: 0 Pa

Mod.	Speed	Qv	WT: 70/60 °C				WT: 60/50 °C				WT: 55/45 °C				WT: 50/40 °C				WT: 50/45 °C				WT: 45/40 °C			
			Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)
		m³/h	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa
CRSO 13	5		595	6,89	593	27,5	5,28	454	17,6	4,48	386	13,3	3,68	316	9,5	4,22	725	42,0	3,42	588	29,3					
	4	MAX	540	6,37	548	23,9	4,89	421	15,3	4,14	356	11,6	3,40	293	8,3	3,90	671	36,5	3,16	544	25,5					
	3	MED	470	5,69	489	19,5	4,37	376	12,5	3,71	319	9,5	3,04	262	6,8	3,49	600	29,9	2,83	487	20,9					
	2	MIN	410	5,09	437	15,9	3,91	336	10,2	3,32	285	7,8	2,72	234	5,5	3,12	536	24,4	2,53	434	17,0					
	1		375	4,71	405	13,9	3,62	312	8,9	3,08	264	6,8	2,53	217	4,9	2,89	497	21,2	2,34	403	14,9					
CRSO 23	5		1040	11,43	983	26,4	8,76	754	16,9	7,42	638	12,8	6,08	523	9,1	7,00	1205	40,5	5,67	976	28,2					
	4	MAX	870	9,95	856	20,6	7,63	656	13,2	6,46	555	9,9	5,29	455	7,1	6,10	1049	31,5	4,94	850	22,0					
	3	MED	765	8,99	773	17,1	6,89	592	11,0	5,83	502	8,3	4,79	412	5,9	5,50	946	26,2	4,46	766	18,3					
	2	MIN	665	8,01	689	13,9	6,15	528	8,9	5,21	448	6,8	4,28	368	4,8	4,91	845	21,4	3,98	685	14,9					
	1		580	7,16	615	11,4	5,50	473	7,3	4,66	401	5,5	3,83	329	3,9	4,39	754	17,4	3,56	612	12,2					
CRSO 33	5		1415	15,74	1354	24,1	12,04	1035	15,4	10,17	875	11,6	8,32	715	8,2	9,64	1658	36,8	7,80	1342	25,6					
	4	MAX	1320	14,90	1281	21,8	11,40	980	13,9	9,64	829	10,5	7,89	678	7,4	9,12	1569	33,4	7,39	1270	23,2					
	3	MED	1150	13,36	1149	17,9	10,23	880	11,5	8,66	745	8,7	7,09	609	6,1	8,19	1408	27,4	6,62	1139	19,1					
	2	MIN	950	11,47	987	13,6	8,78	755	8,7	7,44	640	6,6	6,10	524	4,7	7,01	1206	20,8	5,69	979	14,5					
	1		745	9,36	805	9,4	7,19	618	6,1	6,09	524	4,6	5,00	430	3,3	5,74	986	14,5	4,66	801	10,1					
CRSO 43	5		2220	24,70	2124	24,9	18,91	1626	16,0	16,01	1377	12,0	13,09	1126	8,5	15,12	2601	38,2	–	–	–					
	4		1980	22,61	1945	21,3	17,31	1489	13,6	14,65	1259	10,2	11,99	1031	7,3	13,84	2380	32,5	–	–	–					
	3	MAX	1705	20,09	1727	17,2	15,35	1320	11,0	13,02	1120	8,3	10,68	918	5,9	12,29	2113	26,3	–	–	–					
	2	MED	1360	16,69	1435	12,3	12,78	1099	7,9	10,84	932	6,0	8,89	765	4,2	10,23	1759	18,9	–	–	–					
	1	MIN	1000	12,90	1109	7,7	9,90	851	5,0	8,38	721	3,8	6,89	593	2,7	7,90	1358	11,8	–	–	–					

Heating emission of 4 row coil

Entering air temperature: 20°C – Available pressure: 0 Pa

Mod.	Speed	Qv	WT: 70/60 °C				WT: 60/50 °C				WT: 55/45 °C				WT: 50/40 °C				WT: 50/45 °C				WT: 45/40 °C			
			Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)
		m³/h	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa
CRSO 14	5		595	7,75	667	17,2	5,95	512	11,1	5,06	435	8,4	4,15	357	6,0	4,74	816	26,3	3,86	663	18,5					
	4	MAX	540	7,14	614	14,8	5,48	471	9,5	4,65	400	7,2	3,82	328	5,2	4,37	752	22,7	3,54	610	15,9					
	3	MED	470	6,32	544	11,9	4,86	418	7,7	4,12	355	5,8	3,39	291	4,2	3,87	665	18,2	3,14	540	12,7					
	2	MIN	410	5,60	481	9,6	4,31	370	6,2	3,65	314	4,7	3,01	259	3,4	3,43	590	14,7	2,79	479	10,3					
	1		375	5,17	444	8,3	3,98	342	5,4	3,38	290	4,1	2,78	239	2,9	3,17	545	12,7	2,57	442	8,9					
CRSO 24	5		1040	12,97	1115	26,7	9,97	857	16,9	8,48	729	12,8	6,96	599	9,1	7,94	1367	36,8	5,67	976	28,2					
	4	MAX	870	11,16	960	20,6	8,59	739	13,2	7,30	628	10,5	6,01	517	7,4	6,83	1176	31,5	4,94	850	22,0					
	3	MED	765	10,02	861	17,1	7,71	663	11,0	6,55	564	8,7	5,39	464	6,1	6,13	1054	27,4	4,98	857	18,3					
	2	MIN	665	8,86	762	13,9	6,83	587	8,9	5,80	499	6,8	4,78	411	5,9	5,42	932	24,4	3,98	766	14,9					
	1		580	7,86	676	11,4	6,06	521	7,3	5,16	443	6,1	4,25	365	4,8	4,81	827	20,8	3,56	612	12,2					
CRSO 34	5		1415	17,13	1474	24,1	13,13	1129	15,4	11,12	956	11,6	9,11	783	8,2	10,50	1807	36,8	7,80	1342	25,6					
	4	MAX	1320	16,20	1393	21,8	12,41	1067	13,9	10,51	904	10,5	8,60	740	7,4	9,93	1708	33,4	7,39	1270	23,2					
	3	MED	1150	14,45	1243	17,9	11,08	953	11,5	9,38	806	8,7	7,68	660	6,1	8,85	1523	27,4	6,62	1139	19,1					
	2	MIN	950	12,28	1056	13,6	9,43	811	8,7	7,99	687	6,6	6,55	563	4,7	7,52	1293	20,8	5,69	1048	14,5					
	1		745	9,95	856	9,4	7,64	657	6,1	6,49	558	4,6	5,32	458	3,3	6,09	1047	14,5	4,66	801	10,1					
CRSO 44	5		2220	26,66	2293	24,9	20,40	1754	16,0	17,29	1487	12,0	14,16	1218	8,5	16,30	2804	38,2	–	–	–					
	4		1980	24,24	2084	21,3	18,61	1600	13,6	15,76	1355	10,2	12,90	1110	7,3	14,85	2555	32,5	–	–	–					
	3	MAX	1705	21,43	1843	17,2	16,43	1413	11,0	13,94	1199	8,3	11,41	982	5,9	13,13	2258	26,3	–	–	–					
	2	MED	1360	17,67	1520	12,3	13,57	1167	7,9	11,53	991	6,0	9,45	813	4,2	10,82	1861	18,9	–	–	–					
	1	MIN	1000	13,52	1163	10,9	10,40	894	5,0	8,82	759	3,8	7,25	623	2,7	8,27	1422	11,8	–	–	–					

LEGEND

WT = Water temperature
Ph = Emission
Qw = Water flow

Dp(c) = Water pressure drop
Qv = Air flow
Speed = Fan speed

MAX = High speed
MED = Medium speed
MIN = Low speed

Heating emission of 1 row additional coil

Entering air temperature: 20°C – Available pressure: 0 Pa

			WT: 80/70 °C			WT: 75/65 °C			WT: 70/60 °C			WT: 65/55 °C			WT: 60/50 °C			WT: 55/45 °C			
Mod.	Speed		Qv	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)
			m³/h	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa
CRSO 1	5		595	3,77	324	22,6	3,40	293	19,1	3,04	261	15,8	2,67	230	12,8	2,30	197	9,9	1,93	166	7,4
	4	MAX	540	3,55	305	20,3	3,20	275	17,1	2,85	245	14,1	2,51	216	11,4	2,16	186	8,9	1,82	156	6,6
	3	MED	470	3,24	279	17,2	2,93	252	14,5	2,61	224	12,0	2,29	197	9,7	1,98	170	7,6	1,66	143	5,6
	2	MIN	410	2,96	255	14,6	2,68	230	12,4	2,39	205	10,3	2,10	180	8,3	1,81	156	6,4	1,52	131	4,8
	1		375	2,79	240	13,1	2,52	217	11,2	2,25	194	9,2	1,98	170	7,4	1,71	147	5,8	1,43	123	4,3
CRSO 2	5		1040	5,96	512	13,7	5,37	462	11,5	4,76	409	9,4	4,17	359	7,5	3,57	307	5,8	2,97	256	4,3
	4	MAX	870	5,32	457	11,1	4,79	412	9,4	4,25	366	7,7	3,73	320	6,2	3,19	274	4,7	2,66	229	3,5
	3	MED	765	4,90	421	9,6	4,41	379	8,1	3,92	337	6,7	3,43	295	5,3	2,94	253	4,1	2,46	211	3,0
	2	MIN	665	4,48	385	8,2	4,03	347	6,9	3,58	308	5,7	3,14	270	4,5	2,69	232	3,5	2,25	193	2,6
	1		580	4,09	352	7,0	3,68	317	5,8	3,28	282	4,8	2,87	247	3,9	2,47	212	3,0	2,06	177	2,2
CRSO 3	5		1415	7,68	660	18,2	6,92	595	15,4	6,16	530	12,7	5,40	465	10,2	4,64	399	7,9	3,89	335	5,8
	4	MAX	1320	7,34	631	16,8	6,62	570	14,2	5,89	507	11,7	5,18	445	9,4	4,45	383	7,3	3,73	321	5,4
	3	MED	1150	6,72	578	14,4	6,06	521	12,1	5,40	464	10,0	4,74	407	8,0	4,08	351	6,2	3,41	294	4,6
	2	MIN	950	5,95	512	11,5	5,37	462	9,7	4,79	412	8,0	4,19	361	6,4	3,62	311	5,0	3,03	261	3,7
	1		745	5,08	437	8,7	4,59	394	7,3	4,08	351	6,0	3,59	308	4,9	3,09	266	3,8	2,59	223	2,8
CRSO 4	5		2220	11,93	1026	52,0	10,78	927	44,0	9,63	829	36,6	8,47	729	29,5	7,31	629	23,0	6,17	531	17,3
	4		1980	11,11	956	45,8	10,02	862	38,6	8,95	770	32,0	7,88	678	25,9	6,81	586	20,2	5,73	493	15,1
	3	MAX	1705	10,07	866	38,3	9,11	783	32,5	8,14	700	27,0	7,16	616	21,8	6,19	532	17,0	5,21	448	12,7
	2	MED	1360	8,73	751	29,6	7,88	678	25,0	7,04	605	20,8	6,21	534	16,8	5,36	461	13,1	4,51	388	9,8
	1	MIN	1000	7,13	613	20,6	6,44	554	17,4	5,76	495	14,5	5,08	437	11,7	4,38	377	9,2	3,70	318	6,9

Heating emission of 2 row additional coil

Entering air temperature: 20°C – Available pressure: 0 Pa

			WT: 65/55 °C			WT: 60/50 °C			WT: 55/45 °C			WT: 50/40 °C			WT: 45/40 °C			WT: 45/35 °C			
Mod.	Speed		Qv	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)	Ph	Qw	Dp(c)
			m³/h	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa	kW	l/h	kPa
CRSO 1	5		595	4,59	394	6,0	3,96	341	4,7	3,33	286	3,5	2,69	232	2,4	2,57	442	7,9	2,06	178	1,5
	4	MAX	540	4,29	369	5,3	3,70	318	4,2	3,11	268	3,1	2,52	217	2,2	2,41	414	7,0	1,93	166	1,4
	3	MED	470	3,88	334	4,5	3,35	288	3,5	2,82	242	2,6	2,29	197	1,8	2,17	374	5,8	1,75	151	1,1
	2	MIN	410	3,51	302	3,7	3,04	261	2,9	2,55	219	2,2	2,07	178	1,5	1,97	339	4,9	1,59	137	1,0
	1		375	3,29	283	3,3	2,84	244	2,6	2,39	206	1,9	1,94	167	1,4	1,85	317	4,3	1,49	128	0,9
CRSO 2	5		1040	7,60	654	20,2	6,58	566	15,8	5,55	478	11,9	4,53	389	8,4	4,27	734	26,4	3,49	300	5,3
	4	MAX	870	6,73	579	16,2	5,82	501	12,7	4,92	423	9,5	4,01	345	6,7	3,78	651	21,3	3,10	266	4,3
	3	MED	765	6,15	529	13,8	5,32	458	10,8	4,50	387	8,1	3,67	315	5,7	3,45	594	18,1	2,84	244	3,7
	2	MIN	665	5,56	478	11,5	4,82	414	9,0	4,06	349	6,8	3,32	285	4,8	3,12	537	15,1	2,57	221	3,1
	1		580	5,04	433	9,6	4,35	375	7,5	3,68	317	5,7	3,00	258	4,0	2,83	486	12,6	2,33	200	2,6
CRSO 3	5		1415	10,26	882	46,2	8,90	765	36,4	7,52	647	27,4	6,16	530	19,4	5,77	992	60,8	4,77	410	12,5
	4	MAX	1320	9,79	842	42,4	8,49	730	33,4	7,19	618	25,2	5,87	505	17,9	5,50	946	55,8	4,56	392	11,5
	3	MED	1150	8,92	767	35,9	7,73	665	28,2	6,54	562	21,3	5,34	460	15,1	5,00	860	47,0	4,15	357	9,7
	2	MIN	950	7,79	670	28,1	6,76	581	22,2	5,72	492	16,7	4,68	402	11,8	4,38	753	37,0	3,63	312	7,7
	1		745	6,52	561	20,4	5,66	487	16,1	4,79	412	12,2	3,92	337	8,6	3,67	631	26,9	3,06	263	5,6

LEGEND

WT = Water temperature
Ph = Emission
Qw = Water flow

Dp(c) = Water pressure drop
Ph = Air flow
Speed = Fan speed

MAX = High speed
MED = Medium speed
MIN = Low speed

Air flow (m³/h)
depending on speed and requested available pressure

Mod.	Speed		Available pressure (Pa)								
			0	10	20	30	40	50	60	70	80
CRSO 1	5		595	565	530	495	455	410	355	297	230
	4	MAX	540	507	475	435	395	348	300	245	185
	3	MED	470	437	403	365	327	285	237	187	130
	2	MIN	410	378	344	305	265	225	180	135	—
	1		375	340	302	260	220	178	137	—	—
CRSO 2	5		1040	995	950	900	845	782	720	650	575
	4	MAX	870	825	780	730	680	630	575	515	450
	3	MED	765	710	665	620	572	530	480	430	360
	2	MIN	665	610	560	515	470	430	380	330	—
	1		580	535	495	455	410	370	320	270	—
CRSO 3	5		1415	1375	1325	1270	1200	1120	1040	945	845
	4	MAX	1320	1280	1230	1170	1105	1030	950	860	780
	3	MED	1150	1115	1070	1020	960	890	810	730	650
	2	MIN	950	905	860	810	760	700	640	570	500
	1		745	685	640	600	550	505	460	400	340
CRSO 4	5		2220	2130	2030	1930	1825	1720	1600	1495	1375
	4		1980	1900	1820	1740	1650	1550	1450	1340	1220
	3	MAX	1705	1650	1585	1520	1450	1380	1295	1200	1100
	2	MED	1360	1330	1300	1260	1215	1160	1090	1000	910
	1	MIN	1000	985	975	955	935	900	870	820	750

Power absorption (Watt)
depending on air flow and available pressure

Mod.	Speed		Available pressure (Pa)								
			0	10	20	30	40	50	60	70	80
CRSO 1	5		76	75	73	71	70	68	65	63	60
	4	MAX	65	63	62	60	58	56	54	52	50
	3	MED	54	53	51	49	48	46	44	42	40
	2	MIN	46	45	44	42	41	39	38	36	—
	1		41	40	39	38	36	35	33	—	—
CRSO 2	5		140	137	133	129	124	119	114	109	103
	4	MAX	120	117	114	110	105	101	97	92	86
	3	MED	107	104	101	97	93	90	86	81	76
	2	MIN	95	92	89	86	82	79	75	70	—
	1		88	85	83	80	76	73	69	65	—
CRSO 3	5		174	171	167	162	156	150	143	135	127
	4	MAX	164	161	157	152	146	140	133	125	119
	3	MED	144	141	137	133	128	122	115	108	101
	2	MIN	122	118	114	110	106	101	96	91	85
	1		97	94	91	88	84	81	77	73	68
CRSO 4	5		256	248	238	227	216	204	193	183	173
	4		237	224	212	201	190	179	170	161	151
	3	MAX	219	208	197	187	177	168	158	148	139
	2	MED	191	182	174	165	157	148	139	130	123
	1	MIN	164	156	151	143	136	127	122	115	108

Correction factors for Total cooling emission

Mod.	Speed		Available pressure (Pa)								
			0	10	20	30	40	50	60	70	80
CRSO 1	5		1,00	0,97	0,94	0,91	0,86	0,81	0,74	0,66	0,56
	4	MAX	1,00	0,97	0,93	0,89	0,84	0,78	0,71	0,62	0,51
	3	MED	1,00	0,96	0,92	0,87	0,82	0,75	0,66	0,57	0,45
	2	MIN	1,00	0,96	0,91	0,85	0,78	0,70	0,61	0,50	–
	1		1,00	0,95	0,89	0,81	0,73	0,64	0,54	–	–
CRSO 2	5		1,00	0,98	0,95	0,93	0,89	0,85	0,81	0,76	0,70
	4	MAX	1,00	0,97	0,94	0,91	0,87	0,84	0,79	0,74	0,67
	3	MED	1,00	0,96	0,93	0,89	0,85	0,81	0,76	0,71	0,63
	2	MIN	1,00	0,96	0,91	0,87	0,82	0,78	0,72	0,66	–
	1		1,00	0,96	0,92	0,88	0,82	0,77	0,70	0,63	–
CRSO 3	5		1,00	0,98	0,97	0,94	0,92	0,88	0,84	0,80	0,74
	4	MAX	1,00	0,98	0,96	0,94	0,91	0,87	0,83	0,78	0,74
	3	MED	1,00	0,98	0,96	0,94	0,91	0,87	0,82	0,77	0,72
	2	MIN	1,00	0,97	0,95	0,92	0,89	0,84	0,80	0,74	0,68
	1		1,00	0,96	0,92	0,89	0,85	0,80	0,76	0,69	0,62
CRSO 4	5		1,00	0,98	0,95	0,93	0,90	0,87	0,83	0,80	0,76
	4		1,00	0,98	0,96	0,93	0,91	0,88	0,84	0,80	0,76
	3	MAX	1,00	0,98	0,96	0,94	0,92	0,89	0,86	0,82	0,78
	2	MED	1,00	0,99	0,98	0,96	0,94	0,92	0,89	0,84	0,80
	1	MIN	1,00	0,99	0,99	0,98	0,96	0,95	0,93	0,90	0,85

Correction factors for Sensible cooling emission and Heating emission

Mod.	Speed		Available pressure (Pa)								
			0	10	20	30	40	50	60	70	80
CRSO 1	5		1,00	0,96	0,92	0,88	0,83	0,76	0,68	0,60	0,49
	4	MAX	1,00	0,96	0,91	0,86	0,80	0,73	0,65	0,55	0,45
	3	MED	1,00	0,95	0,90	0,83	0,77	0,69	0,60	0,50	0,38
	2	MIN	1,00	0,94	0,88	0,81	0,73	0,64	0,54	0,43	–
	1		1,00	0,93	0,86	0,77	0,68	0,57	0,47	–	–
CRSO 2	5		1,00	0,97	0,94	0,90	0,86	0,82	0,77	0,71	0,65
	4	MAX	1,00	0,96	0,93	0,88	0,84	0,79	0,74	0,68	0,61
	3	MED	1,00	0,95	0,91	0,86	0,81	0,77	0,71	0,65	0,57
	2	MIN	1,00	0,94	0,89	0,83	0,78	0,73	0,66	0,59	–
	1		1,00	0,94	0,89	0,84	0,78	0,72	0,64	0,57	–
CRSO 3	5		1,00	0,98	0,95	0,93	0,89	0,85	0,80	0,75	0,69
	4	MAX	1,00	0,98	0,95	0,92	0,88	0,84	0,79	0,73	0,68
	3	MED	1,00	0,98	0,95	0,92	0,88	0,83	0,78	0,72	0,66
	2	MIN	1,00	0,97	0,93	0,89	0,85	0,80	0,75	0,69	0,62
	1		1,00	0,94	0,90	0,86	0,80	0,75	0,70	0,63	0,56
CRSO 4	5		1,00	0,97	0,94	0,91	0,87	0,83	0,79	0,75	0,70
	4		1,00	0,97	0,94	0,91	0,88	0,84	0,80	0,75	0,70
	3	MAX	1,00	0,98	0,95	0,92	0,89	0,86	0,82	0,78	0,73
	2	MED	1,00	0,98	0,97	0,95	0,92	0,89	0,85	0,80	0,75
	1	MIN	1,00	0,99	0,98	0,97	0,95	0,93	0,91	0,87	0,81

Operation limits

Highest water inlet temperature.....+ 85 °C

Lowest water inlet temperature.....+ 5 °C

for entering water temperatures below + 5°C, contact “SABIANA” technical department

Highest working pressure..... 1000 kPa (10 bars)

Water flow limits for 3 row coil (l/h)

MODEL	CRSO 13	CRSO 23	CRSO 33	CRSO 43
Lowest	100	150	200	300
Highest	750	1000	2000	3000

Water flow limits for 4 row coil (l/h)

MODEL	CRSO 14	CRSO 24	CRSO 34	CRSO 44
Lowest	150	150	300	400
Highest	1000	1500	2250	3300

Water flow limits for 1 row additional coil (l/h)

MODEL	CRSO 1	CRSO 2	CRSO 3	CRSO 4
Lowest	50	100	100	100
Highest	350	500	750	750

Water flow limits for 2 row additional coil (l/h)


MODEL	CRSO 1	CRSO 2	CRSO 3	CRSO 4
Lowest	100	100	100	–
Highest	350	500	750	–

Motor electrical data (max. absorption)


MODEL		CRSO 1	CRSO 2	CRSO 3	CRSO 4
230/1 50Hz	W	76	140	174	256
	A	0,33	0,64	0,81	1,22

Water pressure drop

3 row coil

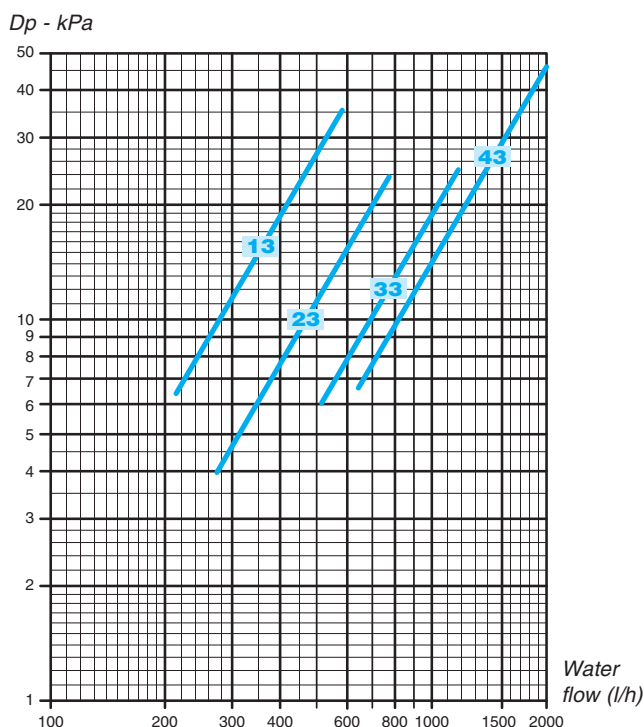


4 row coil

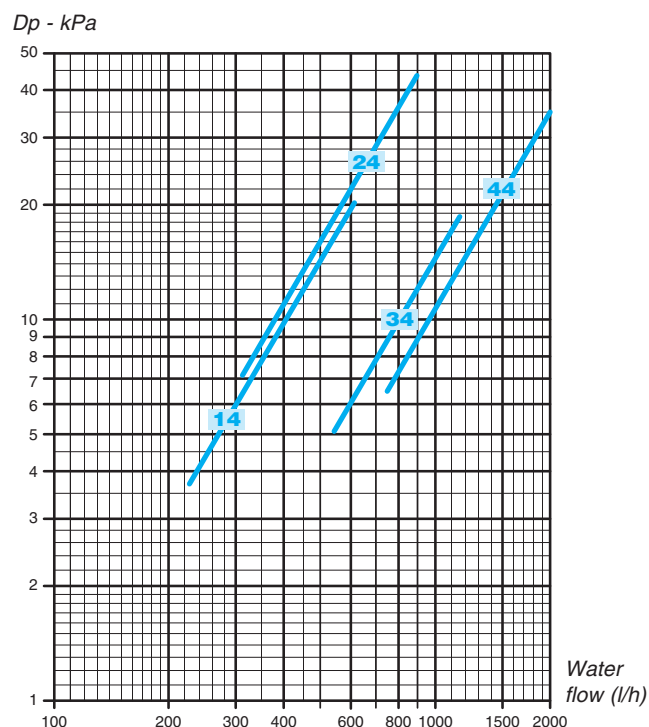


The water pressure drop figures refer to a mean water temperature of **10°C**; for different temperatures, multiply the pressure drop figures by the correction factors K .

°C	20	30	40	50	60	70	80
K	0,94	0,90	0,86	0,82	0,78	0,74	0,70

1 row additional coil

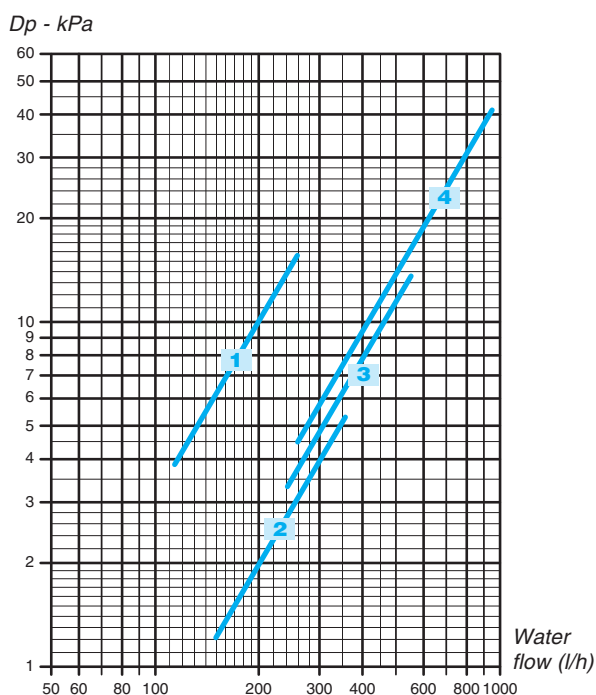

2 row additional coil

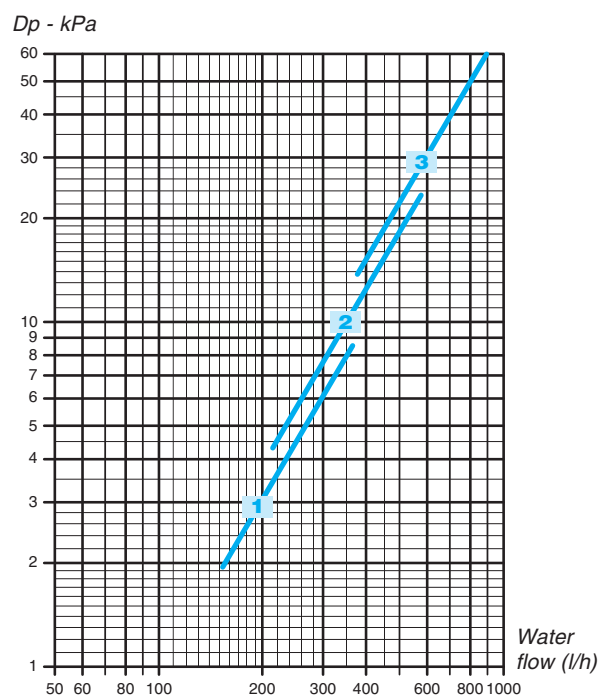


The water pressure drop figures refer to a mean water temperature of **65°C**; for different temperatures, multiply the pressure drop figures by the correction factors K .

°C	40	50	60	70	80
K	1,14	1,08	1,02	0,96	0,90

VBP main coil 3 way valve

Control valve kit:
3 way valve, ON-OFF,
with electric motor and mounting kit
with micrometric lockshield valve.

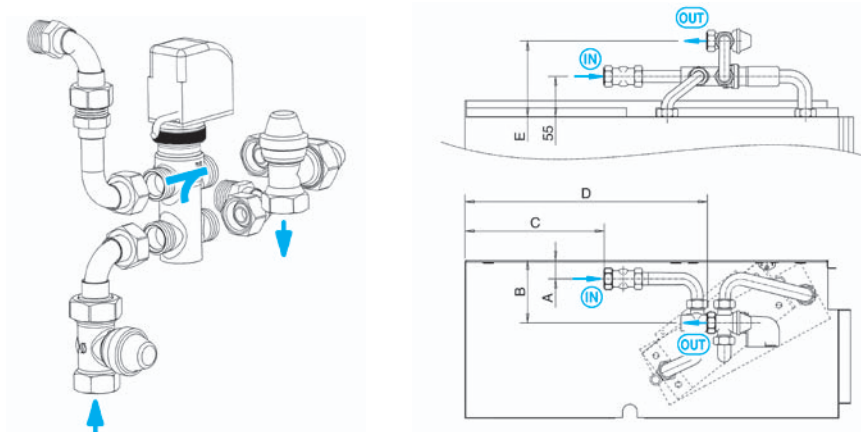


Dimensions ± 10 mm

Mod.	Dimensions (mm)					Valve			Micrometric lockshield valve			Code	
	A	B	C	D	E	DN	($\varnothing$)	Kvs	DN	($\varnothing$)	Kvs	FITTED	NOT FITTED
1	25	85	190	290	105	15	1/2"	1,6	15	1/2" F	2	9066561H	9066560H
2	25	85	190	290	105	20	3/4"	2,5	15	1/2" F	2	9060471H	9060474H
3	50	120	185	290	105	20	3/4"	2,5	15	1/2" F	2	9060471H	9060474H
4	50	120	185	290	105	20	3/4"	4	20	3/4" F	3,5	9069202H	9069200H


VBA additional coil 3 way valve

Control valve kit:
3 way valve, ON-OFF,
with electric motor and mounting kit
with micrometric lockshield valve.

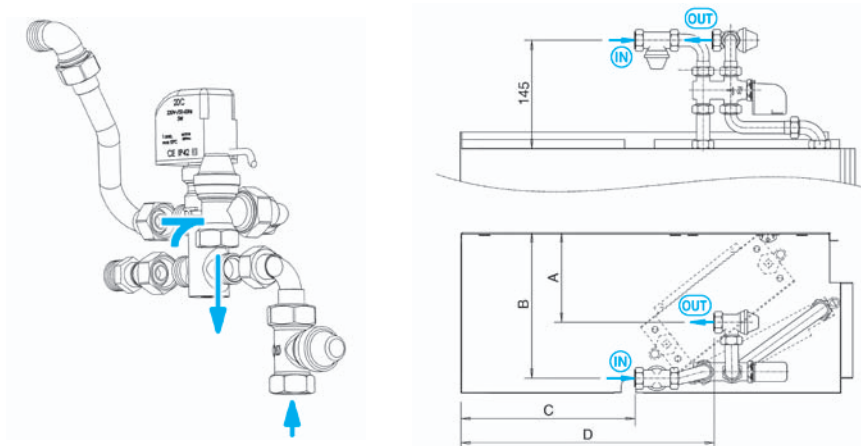



Dimensions ± 10 mm

Mod.	Dimensions (mm)				Valve			Micrometric lockshield valve			Code	
	A	B	C	D	DN	($\varnothing$)	Kvs	DN	($\varnothing$)	Kvs	FITTED	NOT FITTED
1 - 2	120	195	240	340	15	1/2"	1,6	15	1/2" F	2	9060472H	9060475H
3	135	200	235	330	15	1/2"	1,6	15	1/2" F	2	9060472H	9060475H
4	135	200	235	330	15	1/2"	1,6	15	1/2" F	2	9060472H	9060475H

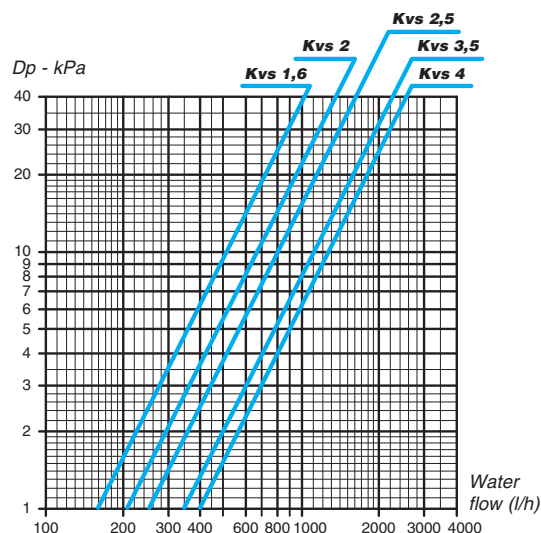

VS simplified kit for 3 way valve

3 way valve, (ON-OFF)
with electric motor and mounting kit.
Valve with flat connection
without micrometric lockshield valve.

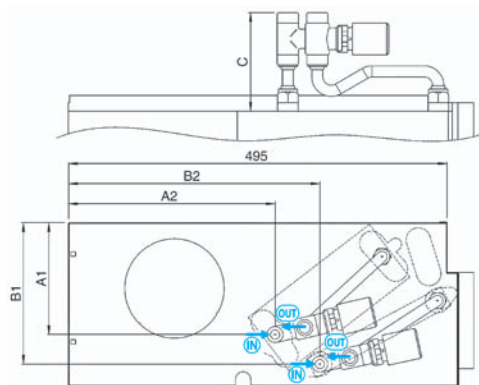
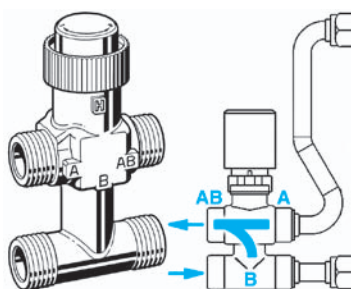


Dimensions ± 10 mm

Mod.	Dimensions (mm)					MAIN					ADDITIONAL				
	MAIN		ADDITIONAL		C	Valve			Code		Valve			Code	
	A1	A2	B1	B2		DN	(Ø)	Kvs	FITTED	NOT FITTED	DN	(Ø)	Kvs	FITTED	NOT FITTED
1	152	270	185	330	116	15	1/2"	1,6	9066571H	9066570H	15	1/2"	1,6	9060483H	9060480H
2	152	268	185	330	124	20	3/4"	2,5	9060484H	9060481H					
3	177	270	210	327	124	20	3/4"	2,5	9060484H	9060481H					
4	177	270	210	329	124	20	3/4"	4	9069205H	9069204H					


V2 2 way valve for main and additional coil

Control valve kit:
2 way valve, ON-OFF,
with electric motor and mounting kit.

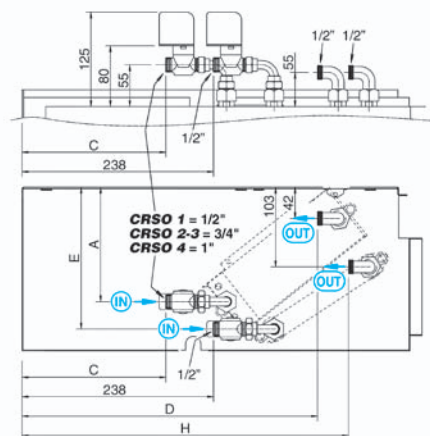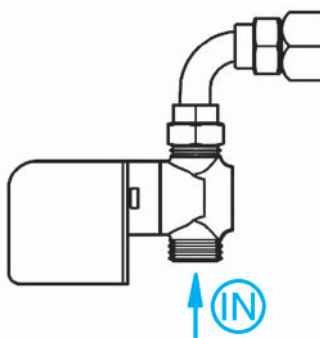



Dimensions ± 10 mm

Mod.	Dimensions (mm)					MAIN					ADDITIONAL				
	MAIN		ADDITIONAL		H	Valve			Code		Valve			Code	
	A	C	D	E		DN	(Ø)	Kvs	FITTED	NOT FITTED	DN	(Ø)	Kvs	FITTED	NOT FITTED
1	149	180	438	186	456	15	1/2"	1,7	9060476H	9060478H	15	1/2"	1,7	9060476H	9060478H
2	150	181	438	186	456	20	3/4"	2,8	9060477H	9060479H					
3	176	175	422	210	440	20	3/4"	2,8	9060477H	9060479H					
4	176	175	422	210	440	25	1"	4	9069203H	9069201H					

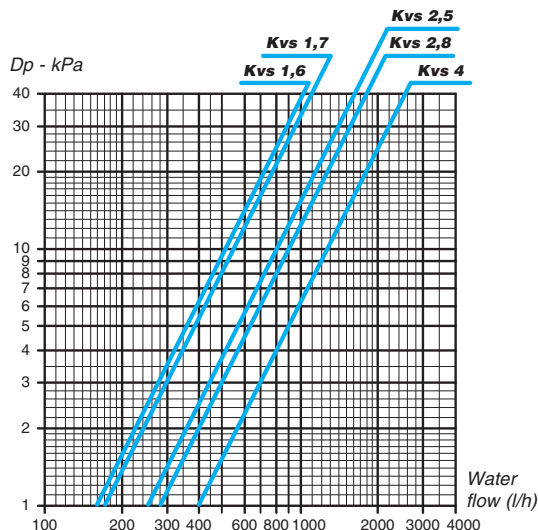

BEL electric heater


1 PHASE 230V

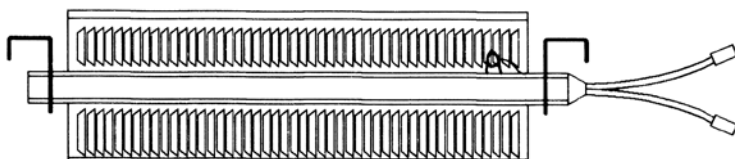Electric heater with integral:
safety thermostat and relay control.

SIZE	CRSO 1			CRSO 2			CRSO 3			CRSO 4
WATT	1500	900	600	2000	1250	750	2500	1500	1000	3500
CODE	9066613	9066603	9066593	9066615	9066605	9066595	9066617	9066607	9066597	9038026

BSV extension condensate collection tray to cover valve assembly


(for vertical units)

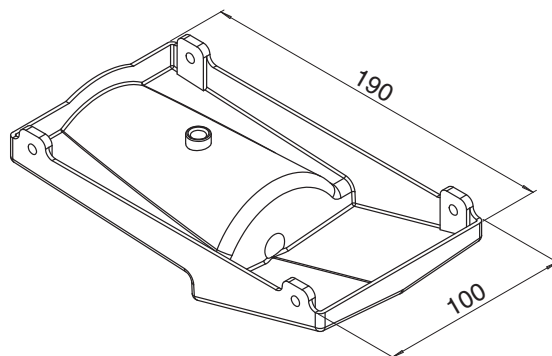

CODE	6060400
------	---------

BSO extension condensate collection tray to cover valve assembly

(for horizontal units)

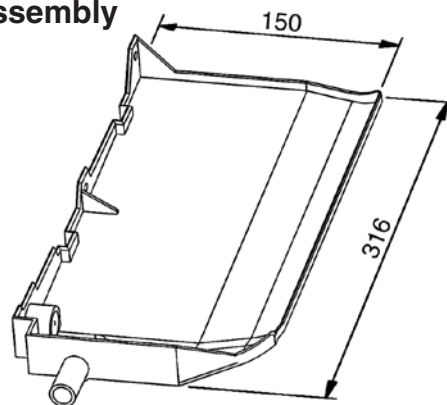


CONNECTION SIDE	LEFT	RIGHT
TYPE	BSO-SX	BSO-DX
CODE	6060402	6060403

DRPV-C condensate pump

(for vertical units)

	FITTED	NOT FITTED
TYPE	DRPV-C-M	DRPV-C-S
CODE	9066297	9066296

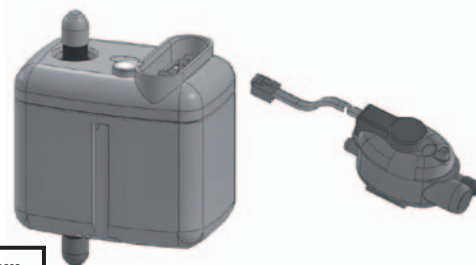


HEIGHT FOR VERTICAL FLOW (m)	WATER FLOW (l/h) DEPENDING ON THE LENGTH OF HORIZONTAL FLOW	
	5 m	10 m
1	7,6	7,2
2	5,6	5,2
3	4,0	3,7
4	3,2	2,9


DRPO-C fitted condensate pump
(for horizontal units)

TYPE	DRPO-C
CODE	9066295

HEIGHT FOR VERTICAL FLOW (m)	WATER FLOW (l/h) DEPENDING ON THE LENGTH OF HORIZONTAL FLOW	
	5 m	10 m
1	7,6	7,2
2	5,6	5,2
3	4,0	3,7
4	3,2	2,9

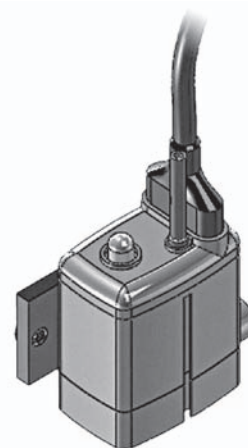

SCR plastic condensate drain pipe with fast connection
(allows correct condensate drain)

CODE	6060420
-------------	---------

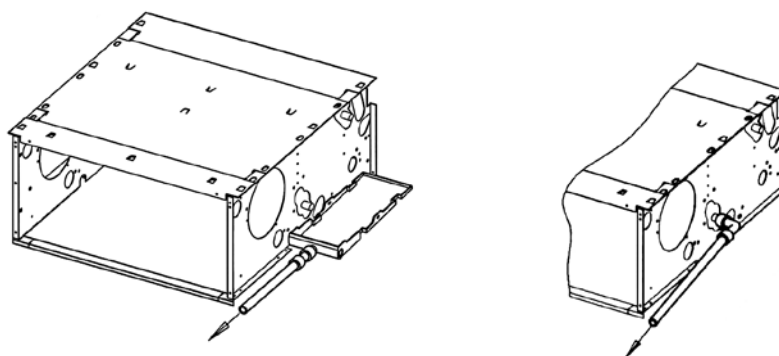

KAF frontal intake kit

Bottom closing panel and filter sliding guides.

SIZE	CODE
CRSO 1	9069071
CRSO 2	9069072
CRSO 3	9069073
CRSO 4	9069074

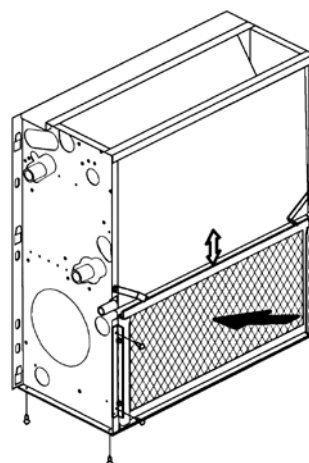
FRD straight inlet flange


Can be used together with GRAG air inlet grid.
Made of galvanized steel.

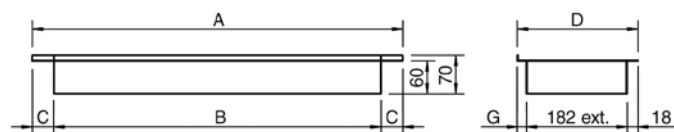

SIZE	TYPE	A	B	C	D	G	CODE
CRSO 1	FRD - 3/4	669	590	39,5	216	16	9060721
CRSO 2	FRD - 4S	884	790	47	246	46	9038002
CRSO 3	FRD - 8/9	1099	990	54,5	246	46	9060724
CRSO 4	FRD - 8S	1549	1440	54,5	246	46	9038007

FR 90 90° inlet flange


Can be used together with GRAP air inlet grid.
Made of galvanized steel.

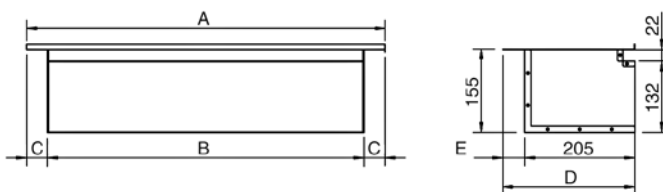

SIZE	TYPE	A	B	C	D	G	CODE
CRSO 1	FR90 - 3/4	669	590	39,5	216	11	9060711
CRSO 2	FR90 - 4S	884	790	47	246	41	9038001
CRSO 3	FR90 - 8/9	1099	990	54,5	246	41	9060714
CRSO 4	FR90 - 8S	1549	1440	54,5	246	41	9038006

GRAP air inlet grid


To be used with FR 90 90° inlet flange.
Made of anodized aluminium.

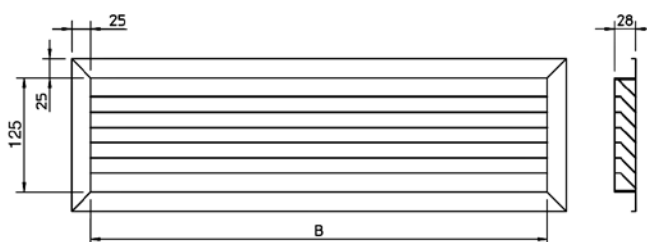

SIZE	TYPE	DESCRIPTION	B	CODE
CRSO 1	GRAP - 3/4	Grid 600x150	575	9060761
CRSO 2	GRAP - 5/6	Grid 800x150	775	9060762
CRSO 3	GRAP - 7/9	Grid 1000x150	975	9060763
CRSO 4	GRAP - S4	Grid 1450x150	1425	9038041

GRAG air inlet grid




To be used with FRD straight inlet flange.
Made of anodized aluminium.

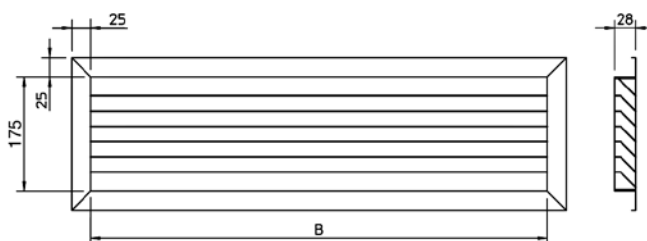

SIZE	TYPE	DESCRIPTION	B	CODE
CRSO 1	GRAG - 3/4	Grid 600x200	575	9060765
CRSO 2	GRAG - 5/6	Grid 800x200	775	9060766
CRSO 3	GRAG - 7/9	Grid 1000x200	975	9060767
CRSO 4	GRAG - S4	Grid 1450x200	1425	9038042

FMD straight outlet flange




Made of galvanized steel.

**CRSO 1-2-3****CRSO 4**

SIZE	TYPE	A	B	C	D	E	CODE
CRSO 1	FMD - 3/4	667	590	38,5	152	-	9066373
CRSO 2	FMD - 4S	882	790	46	179	-	9069232
CRSO 3	FMD - 8/9	1097	990	53,5	179	-	9066378
CRSO 4	FMD - 8S	1547	1440	53,5	152	248	9069234

FM 90 90° outlet flange


Made of galvanized steel
insulated with polyethylene lining.

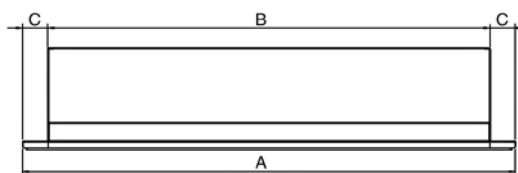**CRSO 1-2-3****CRSO 4**

SIZE	TYPE	A	B	C	D	E	CODE
CRSO 1	FM90 - 3/4	667	590	38,5	152	-	9066383
CRSO 2	FM90 - 4S	882	790	46	179	-	9069242
CRSO 3	FM90 - 8/9	1097	990	53,5	179	-	9066388
CRSO 4	FM90 - 8S	1547	1440	53,5	152	248	9069244

BMA air outlet grid

Double louvre grid to be fitted to the duct,
to the FMD straight outlet flange
or to the FM 90 90° outlet flange.
Made of anodized aluminium.

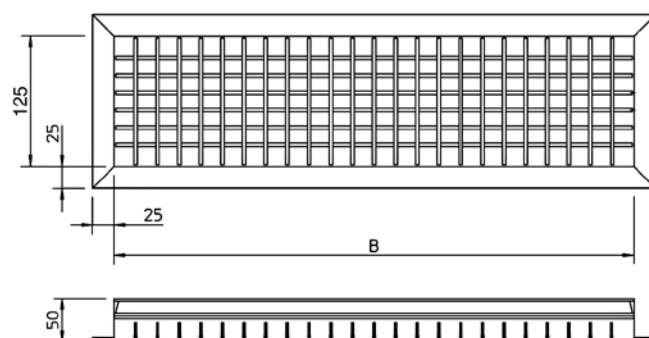


SIZE	TYPE	B	CODE
CRSO 1	BMA - 3/4	575	9060751
CRSO 2	BMA - 5/6	775	9060752
CRSO 3	BMA - 7/9	975	9060753
CRSO 4	BMA - 8S	1425	9038040

PRC air inlet spigot plenum

Made of galvanized steel
insulated with polyethylene lining.

All the plenums are supplied
with spigots for the connection of flexible ducts.

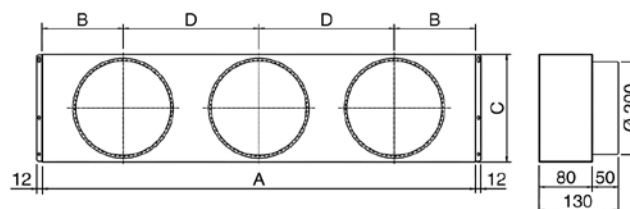


SIZE	TYPE	A	B	C	D	SPIGOTS	CODE
CRSO 1	PRC - 3/4	645	166	218	313	N° 2	9066463
CRSO 2	PRC - 4S	860	160	248	270	N° 3	9038050
CRSO 3	PRC - 8/9	1075	190	248	347,5	N° 3	9066468
CRSO 4	PRC - 8S	1525	223	248	360	N° 4	9038051

PMC spigot diffuser

Made of galvanized steel
insulated with polyethylene lining.

All the plenums are supplied
with spigots for the connection of flexible ducts.

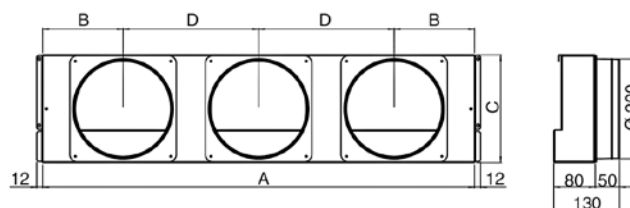

SIZE	TYPE	A	B	C	D	SPIGOTS	CODE
CRSO 1	PMC - 3/4	645	166	218	313	N° 2	9066363
CRSO 2	PMC - 4S	860	160	248	270	N° 3	9069222
CRSO 3	PMC - 8/9	1075	190	248	347,5	N° 3	9066368
CRSO 4	PMC - 8S	1525	223	248	360	N° 4	9069224

Electrical diagrams are shown on the installation, use and maintenance manual

CONTROL OPERATIONS CONTROL IDENTIFICATION	TMO-T-AU-IAQ																9063023														
	TMO-T-IAQ																9063021														
	T2T																9060174														
	TMO-DI																9060165														
	TMO-503-SV2																9060173														
	TMO-T-AU																9060164														
	TMO-T																9060161														
	CR-T																9066330														
	MO-3V																9060160														
		ON-OFF switch	ON-OFF switch for electric heater		Manual 3 speed switch		Manual/Automatic 3 speed selection		Summer/Winter switch		Remote centralized Summer/Winter switch or by an automatic change-over fitted on the water pipe		Automatic Summer/Winter switch with neutral zone for 4 pipe installation with 2 valves		Room thermostat for fan control (ON-OFF)		Room thermostat for 1 valve control (2 pipe installation)		Room thermostat for 2 valve control (4 pipe installation)		Simultaneous thermostatic control of the valves and fan		Room thermostat for chilled water valve (SUMMER) and electric heater (WINTER) control (in winter only the heater is working)		Room thermostat for fan and electric heater control		Installation of electronic low temperature CUT-OUT thermostat (TME)		Installation of bimetallic low temperature CUT-OUT thermostat (TMM)		
		CONTROL CODES																													

Electronic controls

The **CRSO** units can be controlled using the remote controls above;
in the standard version, the motor speeds connected to the main terminal block, are:

- **for sizes 1, 2 and 3** motor speeds 2, 3 and 4 are connected while the wires for speeds 1 and 5 are connected to a two-pole support terminal block.
- **for size 4** motor speeds 1, 2 and 3 are connected while the wires for speeds 4 and 5 are connected to a two-pole support terminal block.

IDENTIFICATION	CODE
MO-3V	9060160



Dimensions: 133x93x37 mm

- ON-OFF switch and 3 speed switch.
- Without thermostatic control.
- It allows to control the low temperature cut-out thermostat (TMM).

IDENTIFICATION	CODE
CR-T	9066330



Dimensions: 133x93x37 mm

- ON-OFF switch.
- Manual 3 speed switch.
- Manual Summer/Winter switch.
- Electronic room thermostat for fan or valve control (ON-OFF).
- It allows to control the low temperature cut-out thermostat (TMM).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter (otherwise please use TMO-T-IAQ control with on/off switch for the electric heater).

IDENTIFICATION	CODE
TMO-T	9060161



Dimensions: 133x93x37 mm

- ON-OFF switch.
- Manual 3 speed switch.
- Summer/Winter switch.
- Electronic room thermostat for fan or valve control (ON-OFF).
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter (otherwise please use TMO-T-IAQ control with on/off switch for the electric heater).
- It allows to control the summer/winter cycle with a centralized and remote switch or with an automatic change-over fitted on the water pipe (for 2-tube installations only).

IDENTIFICATION	CODE
TMO-T-AU	9060164



Dimensions: 133x93x37 mm

- ON-OFF switch.
- Manual or automatic 3 speed switch.
- Summer/Winter switch.
- Electronic room thermostat for fan or valve control (ON-OFF).
- Simultaneous thermostatic control of the valves and fan.
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter (otherwise please use TMO-T-AU-IAQ control with on/off switch for the electric heater).
- It allows to control the summer/winter cycle with a centralized and remote switch or with an automatic change-over fitted on the water pipe (for 2-tube installations only).

N.B.: with 4 pipe installations and continuous chilled and hot water supply, it allows the automatic summer winter change-over in accordance to the room temperature (-1°C = Winter, +1°C = Summer, Neutral Zone 2°C).

IDENTIFICATION	CODE
TMO-503-SV2	9060173



Dimensions: 118x87x8 mm

The TMO-503-SV2 control for fan coils with valves, is designed to be installed in a DIN 503 wall box. It is easy to use, it has a big and clear display, and a great precision. The control is supplied integral with the external frame, but it is possible to use frames of the most known brand on the market (BTicino, Vimar, AVE, Gewiss). The highest working electric absorption is 200 W. If the fan coil has an higher absorption or more units are connected to the same control, the speed switch SEL-CR must be installed (on size 4 the SEL-CR switch must be installed).

- Manual or automatic speed switch.
- Manual Summer/Winter switch.
- Electronic thermostat for valves control (ON-OFF).
- Simultaneous thermostatic control of the valves and fan.
- It allows to control the low temperature cut-out thermostat, included with the control.

N.B.: with 4 pipe installations and continuous chilled and hot water supply, it allows the automatic summer/winter change-over in accordance to the room temperature (-1°C = Winter, +1°C = Summer, Neutral Zone 2°C).

IDENTIFICATION	CODE
TMO-DI	9060165



Dimensions on the wall: 133x93x27 mm
Dimensions in the DIN 503 box: 133x93x18 mm

To be installed on the wall or in the DIN 503 box.

- Manual or automatic speed switch.
- Manual or centralized Summer/Winter switch.
- Electronic thermostat for fan control (ON-OFF).
- Electronic thermostat for valve control (ON-OFF).
- Simultaneous thermostatic control of the valves and fan.
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter.
- It allows to control the fan and the electric heater.
- It allows to control up to 10 units with SEL-DI speed switch.

N.B.: with 4 pipe installations and continuous chilled and hot water supply, it allows the automatic summer/winter change-over in accordance to the room temperature (-1°C = Winter, +1°C = Summer, Neutral Zone 2°C).

IDENTIFICATION	CODE
T2T	9060174



Dimensions: 128x75x25 mm

2 pipes units only.

- ON-OFF switch.
- 3 speed switch.
- Manual Summer/Winter switch.
- Thermostatic control on the fan.
- Thermostatic control on the valve and continuous fan operation.
- Simultaneous thermostatic control of the valve and fan.
- Cannot be used with speed switch (master-slave).

IDENTIFICATION	CODE
TMO-T-IAQ	9063021



Dimensions: 133x93x37 mm

- ON-OFF switch.
- Manual 3 speed switch.
- Summer/Winter switch.
- Electric heater ON-OFF switch.
- Electronic room thermostat for fan or valve control (ON-OFF).
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter.
- It allows to control the summer/winter cycle with a centralized and remote switch or with an automatic change-over fitted on the water pipe (for 2-tube installations only).

IDENTIFICATION	CODE
TMO-T-AU-IAQ	9063023



Dimensions: 133x93x37 mm

- ON-OFF switch.
- Manual or automatic 3 speed switch.
- Summer/Winter switch.
- Electric heater ON-OFF switch.
- Electronic room thermostat for fan or valve control (ON-OFF).
- Simultaneous thermostatic control on the valves and fan.
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter.
- It allows to control the summer/winter cycle with a centralized and remote switch or with an automatic change-over fitted on the water pipe (for 2-tube installations only).

N.B.: with 4 pipe installations and continuous chilled and hot water supply, it allows the automatic summer/winter change-over in accordance to the room temperature (-1°C = Winter, +1°C = Summer, Neutral Zone 2°C).

IDENTIFICATION	CODE
TMO-DI	9060165




Dimensions on the wall: 133x93x27 mm
Dimensions in the DIN 503 box: 133x93x18 mm

- To be installed on the wall or in the DIN 503 box.
- Manual or automatic speed switch.
- Manual or centralized Summer/Winter switch.
- Electronic thermostat for fan control (ON-OFF).
- Electronic thermostat for valve control (ON-OFF).
- Simultaneous thermostatic control of the valves and fan.
- It allows to control the low temperature cut-out thermostat (TME).
- It allows to control the chilled water valve (ON-OFF) and the electric heater (BEL) only in case that hot water is not used in winter.
- It allows to control the fan and the electric heater.
- It allows to control up to 10 units with SEL-DI speed switch.


N.B.: with 4 pipe installations and continuous chilled and hot water supply, it allows the automatic summer/winter change-over in accordance to the room temperature (-1°C = Winter, +1°C = Summer, Neutral Zone 2°C).

IDENTIFICATION	CODE
SEL-CR	9066311

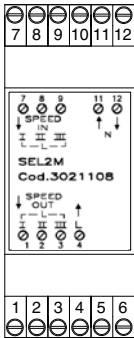

- Speed switch (Slave).
- It allows to control up to 8 units with only one centralized wall control (1 speed switch for each unit).
- For controls CR-T, TMO-T, TMO-T-AU and TMO-503-SV2.

IDENTIFICATION	CODE
SEL-DI	9060139

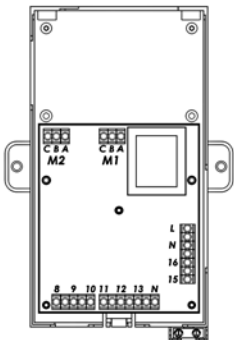

- Speed switch (Slave) for TMO-DI
- It allows to control up to 10 units with only one TMO-DI centralized wall control.

TME low temperature cut-out thermostat

To be fitted between the coil fins; when connecting the control, the TME probe cable must be separated from the power supply wires.

To be used with the following controls:

TMO-T, TMO-T-AU, TMO-DI and corresponding IAQ controls.

It stops the fan when

the water temperature is lower than 38°C

and it starts the fan when is higher than 42°C.



CODE

3021091

TMM low temperature cut-out thermostat

To be installed in contact with the hot water circuit.

To eliminate cold air blow.

Installed by the installing engineer.


To be used with the MO-3V and CR-T controls.

For units working on heating only.

It stops the fan when

the water temperature is lower than 30°C

and it starts the fan when is higher than 38°C.

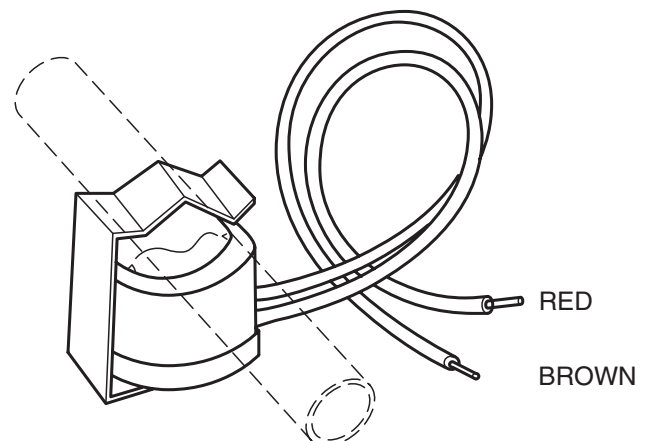

CODE

9053048

Change-Over CH 15-25

Automatic summer/winter switch


to be installed in contact with the water circuit.

For 2-tube installations only

(not to be used with 2 way valve).

To be used with the following controls:

TMO-T, TMO-T-AU, TMO-DI.

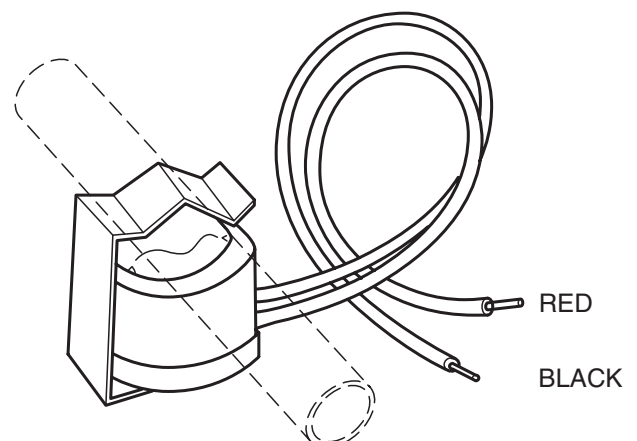

CODE

9053049



FreeSabiana

Free Sabiana is an innovative, **fully wireless**, electronic system for use with fan coil units, based on radio communication.

This technology **provides installation flexibility and a more accurate measurement of the room temperature**. The probe can be moved until the most suitable position is found, without the worry of changes in the room layout and of its furniture and also without mounting it on a wall.

If a new fan coil unit is added, no electrical wiring for the control system is required: just define the control unit and the probe which regulates it. The improved measurement accuracy is a result of the possibility to position the probe near the user location: this enables to keep the temperature exactly at the required value with more energy savings compared with a traditional measurement system.

Transmission is based on communication protocol IEE802.15.4, the most suitable way to transmit a relatively low amount of information with very low consumption and high reliability.

The system has been certified by a leading independent body, officially recognized by the EU authorities and its sale has been authorized in all the EU and EFTA countries.

Main components

Free Sabiana includes 3 main components:

- A remote **control** which features a button panel and LCD display and can be wall-mounted or positioned on a dedicated table support. It enables the control of all the operating variables of the fan coil units in different configurations. The control is battery powered. The temperature and the operating speed of the fan coil unit are set with two large buttons featuring user friendly graphics.

DESCRIPTION	IDENTIFICATION	CODE
Remote control	Free-Com	9060572



Control unit with support

- A **power unit** to be installed on the fan coil (fan coil interface). It controls the fan and the valves of the fan coil. The power unit is connected to the electric supply. The power unit receives the information required to control the fan coil both from the remote control and locally, such as the temperature of the coil.

DESCRIPTION	IDENTIFICATION	CODE
Power unit fitted on the unit	Free-Upm	9060571
Power unit not fitted on the unit	Free-Ups	9060570



Power unit

- A room **temperature probe**, which can be wall-mounted or positioned on a dedicated table support. It is a battery powered device, able to measure the air temperature in the spot where it is positioned, generating temperature information which is communicated to the other devices.

DESCRIPTION	IDENTIFICATION	CODE
Temperature probe	Free-Sen	9060573



Probe with support

Main features of the remote control


The control enables:

- Fan coil on/off switching
- Fan speed selection (high - medium - low - automatic)
- Summer/winter operation selection
- Valve on/off
- Real time clock setting
- Temperature setting
- Daily switch on/off setting (timer function)
- Enable/disable the timer function
- Activation of the (optional) electrostatic filter
- Activation of the (optional) electric heater




Main information displayed:

- ① On-off status
- ② Summer operation
- ③ Winter operation
- ④ Automatic season change
- ⑤ Electric heater
- ⑥ Electrostatic filter
- ⑦ Room temperature (with decimal accuracy)

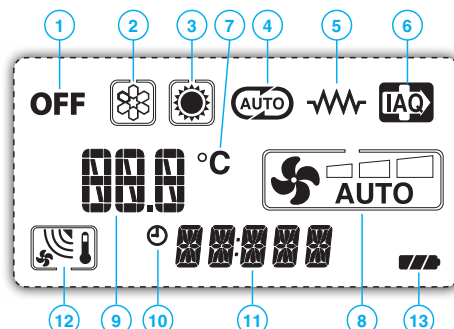

- ⑧ Fan operating speed
- ⑨ Required/measured temperature
- ⑩ Timer
- ⑪ Clock
- ⑫ Transmission signal
- ⑬ Battery level

Main features of the power unit to be installed on the fan coil

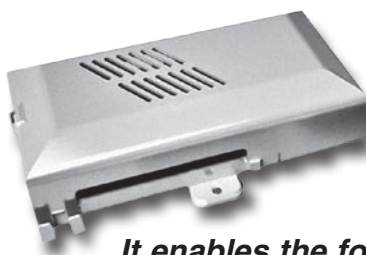

The power unit controls the fan and the valves of the fan coil. The power unit receives the information required to control such units both from the remote control and locally.

It enables the following main actions:

- Fan on/off at a set speed
- Fan speed change (fan on/off)
- Water valve/s on/off (1 valve for 2 tube system - 2 valves for 4 tube system)
- Fan speed change operating the water valve/s
- Control of the electric heater as main heating unit or as integration to the battery supplied with hot water
- Control of the operation of the electrostatic filter (in parallel to the fan)
- Management of the dead zone function for 4-tube systems
- Available functional inputs:
 - Consent for remote on/off
 - Consent for remote Summer/Winter switch (centralized)
 - Consent for the activation of the Energy Saving function with setting change
 - Minimum probe
 - Probe for season change

Main features of the temperature probe



This device is able to measure the temperature of the air in the spot where it is positioned and to transmit it by means of radio communication to the other devices in the system. It is battery powered and can be freely positioned in the area to be air-conditioned.

Display:

- Measured environment temperature
- Transmission signal
- Clock
- Battery status


All the **Carisma CRSO** units can be supplied with a wide range of controls, which allows managing one single unit or several units by using the Modbus RTU - RS 485 communication protocol. Units can be managed according to the Master/Slave logic (up to 20 units) or by supervisory components. The system consists in a **MB** board and a series of controls, such as the **T-MB** wall control, the **RT03** infra-red remote control, the **PSM-DI** multifunction control and the **Sabianet** supervisory program.

MB electronic board

DESCRIPTION	IDENTIFICATION	CODE
MB electronic board fitted on the unit	MB-M	9066332
MB electronic board supplied with separate packaging	MB-S	9066333

The **MB** electronic board, to be mounted on the fan coil internal unit, is set to carry out different functions and adjustment modes, in order to meet the installation requirements. These modes are selected by setting the configuration dip switches on the board.

- 2/4 pipe system.
- Fan ON/OFF thermostatic control.
- Valve ON/OFF thermostatic control and continuous ventilation.
- Valve and simultaneous ventilation ON/OFF thermostatic control.
- Fan operation control depending on the coil temperature (cut-out T3 probe fitted), which can be activated only in heating mode or heating and cooling mode.
- Automatic switch of the operating mode by means of T2 water probe (optional) applied on the 2 pipe system.
- Seasonal switch by means of remote contact.
- ON/OFF of the fan coil by means of the remote contact (window or clock contact).
- Electric heater control.

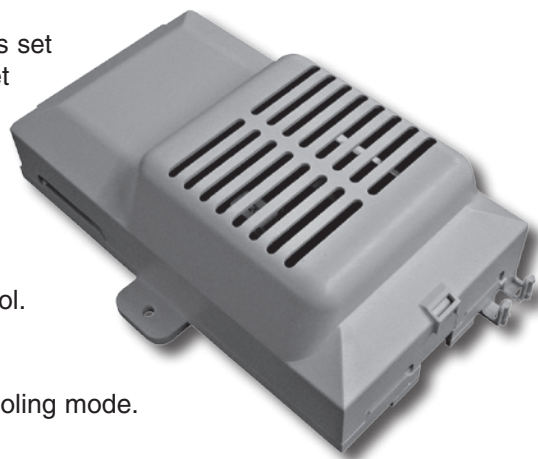

By activating the cut-out T3 probe function, the fan is stopped in winter when the coil temperature is lower than 32°C and started when the temperature reaches 36°C. In summer mode, the fan stops when the temperature inside the coil exceeds 22°C and starts when it drops below 18°C.

The following connections are located on the power board:

- Receiver for infra-red remote control.
- T-MB wall mounted control.
- RS 485 serial connection to manage several fan coils in Master/Slave configuration or to create a supervisory network.

T-MB wall control

DESCRIPTION	IDENTIFICATION	CODE
Wall control (to be used with MB board only)	T-MB	9066331E

Wall control with display that allows controlling one or more units in Master/ Slave mode. The control is equipped with internal sensor to detect the room temperature, which can be defined as a priority compared to the return air sensor on the fan coil. The **T-MB** control features the following functions:

- Switch the appliance ON and OFF.
- Temperature set.
- Modify the set point (when used as a +/- 3° variation of the set point configured from Sabianet supervisory program or PSM-DI).
- Set the fan speed (low, medium, high or autofan).
- Set the operation mode (fan only, cooling, heating; auto for 4 pipe systems with mode selection depending on the air temperature).
- Time setting.
- Weekly ON/OFF program.
- Display and change of the fan coil operation parameters.

**RT03 infra-red remote control**

DESCRIPTION	IDENTIFICATION	CODE
RT03 infra-red remote control with receiver supplied with separate packaging (to be used with MB board only)	RS-RT03	9066337
RT03 infra-red remote control supplied with separate packaging (to be used with MB board only)	RT03	3021203
Receiver for RT03 infra-red remote control supplied with separate packaging (to be used with MB board only)	RS	9066338

The infra-red remote control allows setting by a remote position the fan coil operation parameters. The **RT03** infra-red remote control features the following functions:

- Switch the appliance ON and OFF.
- Temperature set.
- Set the fan speed (low, medium, high or autofan).
- Set the operation mode (fan only, cooling, heating; auto for 4 pipe systems with mode selection depending on the air temperature).
- Time setting.
- 24 hours ON/OFF program.



INSTALLATION EXAMPLE
WITH INFRA-RED REMOTE CONTROL

A group of **Carisma CRSO** units with **MB** electronic board can be connected via a serial link and can consequently be managed at the same time by just one **T-MB** wall control or **RT03** infra-red remote control. Using the special jumper present on the **MB** board, one unit must be configured as the master, and all the others as slaves. It is clear that the remote control must be pointed at the receiver on the master unit. To avoid problems, it is recommended to install and connect the receiver only on the master unit.

With **T-MB** wall control


One control for each unit

(MAXIMUM LENGTH OF THE CONNECTION CABLE = 20 m)



One control for more units (20 units max.)

(MAXIMUM TOTAL LENGTH OF THE CONNECTION CABLE = 800 m)

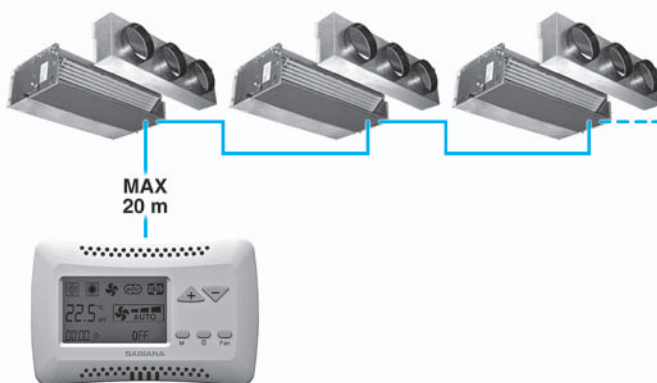


With **RT03** infra-red remote control

One control for each unit



One control for more units (20 units max.)

(MAXIMUM TOTAL LENGTH OF THE CONNECTION CABLE = 800 m)

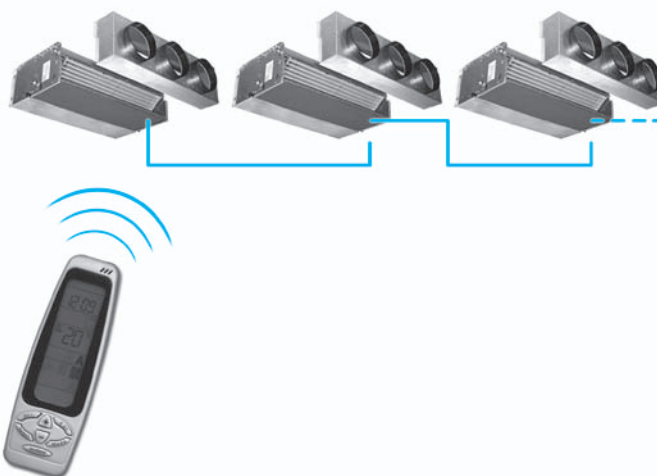

T2 accessory for units with MB electronic board

IDENTIFICATION	CODE
T2	9025310



The T2 sensor can be combined with MB boards to be placed on the water supply pipe upstream 3 way valves (not to be used with 2 way valve).

The T2 sensor must be used as described below:


- Change-Over for 2-pipe system for the automatic switch of the operating mode.
If water temperature is lower than 20°C, cooling mode is set; on the other hand, if water temperature exceeds 30°C, heating mode is set.
- It can be used on units with electric heater and hot water supply. The T2 priority probe activates the electric heater or water valve, depending on the water temperature detected. If water temperature exceeds 34°C, the water valve ON-OFF control is activated; on the other hand, if water temperature is lower than 30°C, the electric heater is activated.

PSM-DI multifunction control panel

DESCRIPTION	IDENTIFICATION	CODE
Multifunction control panel (to be used with MB board only)	PSM-DI	3021293

Another option available for the serial communication between the units is the possibility to connect up to 60 **Carisma CRSO** units in series and manage them with just one wall mounted **PSM-DI** controller. The wall mounted controller can be used to set the operating mode for each individual unit connected, display the operating conditions of each individual unit, and set the ON/OFF time sets for each day of the week (the program can be set for all the units and for a maximum of two groups of units).

If more than 60 units need to be connected, two or more controllers must be used. Each unit must have a MB board. The **PSM-DI** control is used to manage a series of fan coils, up to a maximum of 60 units (the maximum length of the RS 485 connection cable must not exceed 800 m), from one single control point.

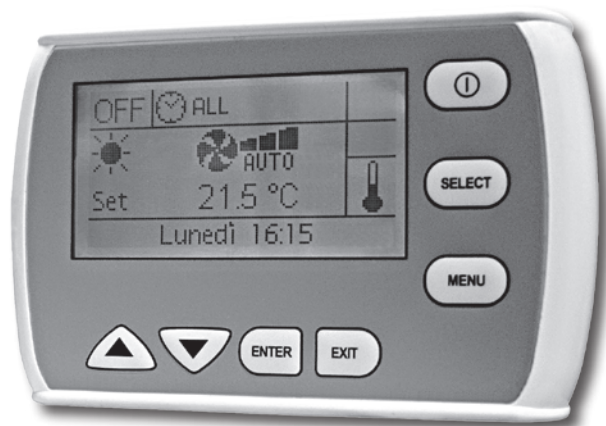

The **PSM-DI** control communicates via a serial line with all the units connected, with the possibility of controlling them all together or individually. In fact, the unique address of each individual fan coil means that all the units can be called at the same time, or the individual unit called, to perform the following functions:

- display the current operating mode, the fan speed, the set point;
- display the room temperature measured on the individual unit;
- turn all the units ON and OFF at the same time or alternatively each unit individually;
- change the operating mode (fan only, heating, cooling, automatic changeover);
- change the set point;
- modify the values and operation parameters of the fan speed.

Each function can then be sent to all the units connected, or alternatively to each individual unit.

Different set points or operating modes can be set for each individual unit.

The **PSM-DI** panel can also be used for the time management of the units over the week. Four ON times and four OFF times can be set on the units for each day of the week. A different Temperature set that will be considered as Operation set for all connected appliances, can be set for each event. If the Temperature set is not entered for the individual event, it must be set during programming for each individual unit or for the entire network.

Units without receiver or with receiver can be connected within the network: the former can receive instructions only from the **PSM-DI** wall mounted panel; while the latter can receive information from both the wall mounted panel (**PSM-DI**) and infra-red remote control. Use the infra-red remote control to force ON mode of the individual unit, if ON/OFF daily time programming has been set. The unit will regain the settings from the **PSM-DI** panel during execution of successive start-up program.

The PSM-DI panel cannot be used together with the Sabianet management program (see next page).

Note: set the configuration Dip Switches of each fan coil as illustrated in the remote control use manual, based on the required solutions.

Note: the RS 485 network's overall length must not exceed 700/800 metres.

Sabianet program for managing a network of Sabiana MB fan coils

DESCRIPTION	IDENTIFICATION	CODE
Hardware/software supervisory system (to be used with MB board only)	Sabianet	9079118

Sabianet is a centralised control system for networks of Sabiana MB fan coils, based on software that runs on LINUX™.

The **Sabianet** software offers a practical and economical solution for managing the units, with the simple click of the mouse.

The main characteristics include simplicity of use, an extremely complete and functional weekly program, and the possibility to access the historical operating data for each individual unit connected.

The program exploits all the potential of our units with remote controls, representing an addition to the latter.

The **Sabianet** program is a control tool that can be used as a replacement for the remote control, or in parallel, however the settings made using **Sabianet** can have priority over those made using the remote control.


The program can be used to:

- Create uniform groups (groups of units on individual floors, in offices or rooms).
- Save weekly programs configured for different types of operation (summer, winter, mid seasons, closing periods etc.); these can then be recalled and activated with a simple click of the mouse. Weekly on/off cycles can be set for individual units or groups of units.
- Set the operating conditions for each individual unit or groups of units (operating mode, fan speed, temperature setting).
- Set the set point limits for each individual unit or groups of units.
- Switch each individual unit or groups of units ON or OFF.

The main program screen can display and interact with the entire network of units. An individual unit, a group of units or the entire network can be called so as to make modifications to the operating mode and the set point. The user can then check the operating status of each individual unit, read the room temperature, the coil temperature and the operating status of the condensate drain pump or any alarms.



“MONITORING” SCREEN

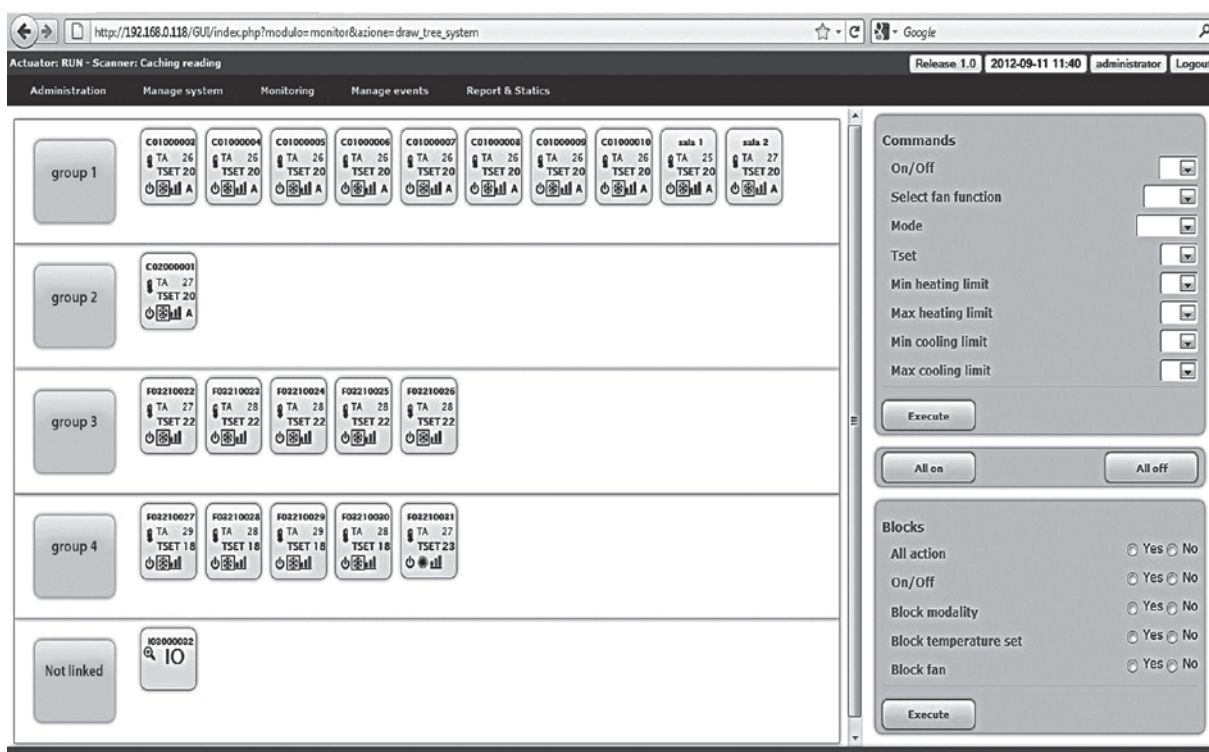


Displaying a unit

The “**MONITORING**” SCREEN shows the units that are connected to the network and scanned by the program.

The icon of the terminal unit provides the following information:

- Unit name (**C01000001**)
- Set temperature (TSET)
- Room temperature (TA)
- Unit status: ON  or OFF 
- Mode:
 -  Summer
 -  Winter
 -  Auto
 -  Fan only
- Fan speed:
 -  Low
 -  Medium
 -  High
 -  AutoFan



Commands

On/Off

Select fan function

Mode

Tset

Min heating limit

Max heating limit

Min cooling limit

Max cooling limit

The “Weekly Program” can be used to set the unit operating parameters for each day of the week. Up to 20 different weekly programs can be set.

“EVENT MANAGEMENT” SCREEN

Actuator: RUN - Scanner: Caching reading

Administration Manage system Monitoring Manage events Report & Statics

Release 1.0 2012-09-11 11:53 administrator Logout

Program name: summer mode 1

Start date: 11/9/2012 End date: 22/9/2012

Set day: Monday Copy by day: Anyone

Group: group 2, group 4, group 1, group 3

Devices: room 1, room 2, C01000003, C01000004, C01000005

State: On Mode: Fan Temperature: 10°C Fan speed: Auto Time start: 00:00


Mouse click to select
CTRL + mouse click to undo select
SHIFT + mouse click to multiple select

Monday	Tuesday	Wednesday	Thursday	Friday	Saturday	Sunday
06:00On Cold 20% Med	06:00On Cold 20% Med	06:00On Cold 20% Med	06:00On Cold 20% Med	06:00On Cold 20% Med	---	---
06:30Off Cold 20% Med	06:30Off Cold 20% Med	06:30Off Cold 20% Med	06:30Off Cold 20% Med	06:30Off Cold 20% Med	---	---
07:00On Cold 20% Med	07:00On Cold 20% Med	07:00On Cold 20% Med	07:00On Cold 20% Med	07:00On Cold 20% Med	---	---
07:30Off Cold 20% Med	07:30Off Cold 20% Med	07:30Off Cold 20% Med	07:30Off Cold 20% Med	07:30Off Cold 20% Med	---	---
08:00On Cold 20% Med	08:00On Cold 20% Med	08:00On Cold 20% Med	08:00On Cold 20% Med	08:00On Cold 20% Med	---	---
08:15Off Cold 20% Med	08:15Off Cold 20% Med	08:15Off Cold 20% Med	08:15Off Cold 20% Med	08:15Off Cold 20% Med	---	---
09:00On Cold 20% Med	09:00On Cold 20% Med	09:00On Cold 20% Med	09:00On Cold 20% Med	09:00On Cold 20% Med	---	---
09:30Off Cold 20% Med	09:30Off Cold 20% Med	09:30Off Cold 20% Med	09:30Off Cold 20% Med	09:30Off Cold 20% Med	---	---

Time bands are available for each day of the week. The time and the type of operation to be performed by the unit can be set for each band. The time and the operating parameters can then be displayed before being sent to the unit and implemented.

PC **Sabianet** Software

Connection
of a **Carisma CRSO** network
with MB electronic board

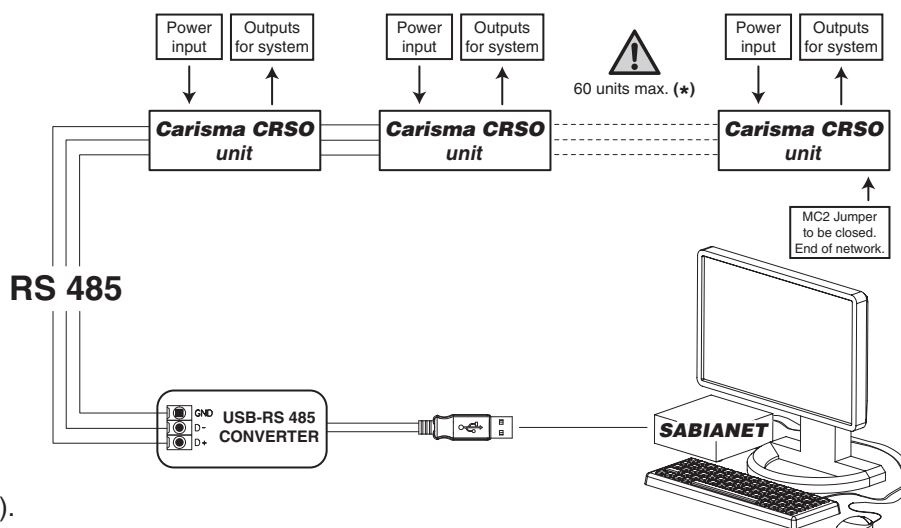

(*) In the event
of more than 60 units, add
one or more Router-S (see below).

RS 485 serial connection cable

Shielded cable to be used:

Belden 9841, RS-485, 1x2x24 AWG SFTP, 120 Ohm




PSM-DI and Sabianet electronic boards for **HPO** units

IDENTIFICATION	CODE
SIOS	3021292

SIOS is a board equipped with 8 relays with potential free contact to control the activation or deactivation of remote electric utilities. Moreover, the board has 8 digital inlets to display the actuators or external consents, such as motor or other. The SIOS boards can be connected:

- inside a network managed by Sabianet;
- to a PSM-DI panel (one SIOS for each PSM-DI panel).

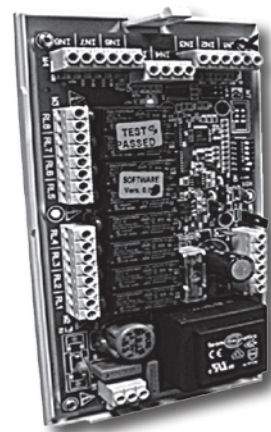

IDENTIFICATION	CODE
Router-S	3021290


The Router-S is an electronic board that:

- allows creating networks with more than 60 units (minimum 2 Router-S are required) or to divide the network (per floor, building, etc.);
- it allows creating a Master/Slave sub-network to be controlled as an independent group.

The Router-S can be used only inside a network managed by Sabianet.

The number of Router-S to be used is:

- up to 60 units: no Router-S
- from 61 to 120 units: 2 Router-S
- every 60 subsequent units: 1 additional Router-S

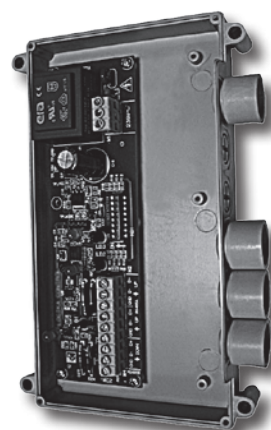



www.icim.it

CERTIFICATO n. **0545/5**
CERTIFICATE No. _____

SI CERTIFICA CHE IL SISTEMA DI GESTIONE PER LA QUALITÀ DI
WE HEREBY CERTIFY THAT THE QUALITY MANAGEMENT SYSTEM OPERATED BY

SABIANA S.p.A.

UNITÀ OPERATIVE
OPERATIVE UNITS

Sede e Unità Operativa
Via Piave, 53 - 20011 Corbetta (MI)
Unità Operativa
Via Virgilio, 2 - 20013 Magenta (MI)
Italia

E' CONFORME ALLA NORMA
IS IN COMPLIANCE WITH THE STANDARD

UNI EN ISO 9001:2008

PER LE SEGUENTI ATTIVITÀ
FOR THE FOLLOWING ACTIVITIES

EA: 18

Progettazione, produzione e assistenza di apparecchiature per il riscaldamento e il condizionamento dell'aria (aerotermi, termostrisce radianti, ventilconvettori e unità trattamento aria) e canne fumarie.

Design, production and service of heating and air conditioning equipment (unit heaters, radiant panels, fan coil units and air handling units) and chimneys.

Riferirsi al Manuale della Qualità per l'applicabilità dei requisiti della norma di riferimento.
Refer to Quality Manual for details of application to reference standard requirements.

Il presente certificato è soggetto al rispetto del regolamento per la certificazione dei sistemi di gestione per la qualità delle aziende.
The use and the validity of this certificate shall satisfy the requirements of the rules for the certification of company quality management systems.

Data emissione
First issue
10/06/1996

Emissione corrente
Current issue
10/04/2012

Data di scadenza
Expiring date
09/04/2015

ICIM S.p.A.

Piazza Don Enrico Mapelli, 75 - 20099 Sesto San Giovanni (MI)



SGQ N° 004A
SGA N° 005D
SCR N° 006F

SSI N° 008G
PRD N° 004B
ISP N° 045E

Membro degli Accordi di Mutuo Riconoscimento EA, IAF e ILAC
Signatory of EA, IAF and ILAC Mutual Recognition Agreements

CISQ is a member of



*IQNet, the association of the world's first class certification bodies, is the largest provider of management System Certification in the world.
IQNet is composed of more than 30 bodies and counts over 150 subsidiaries all over the globe.*

CISQ è la Federazione Italiana di Organismi di Certificazione dei sistemi di gestione aziendale.

CISQ is the Italian Federation of management system Certification Bodies.



www.cisq.com

The descriptions and illustrations provided in this publication are not binding: Sabiana reserves the right, whilst maintaining the essential characteristics of the types described and illustrated, to make, at any time, without the requirement to promptly update this piece of literature, any changes that it considers useful for the purpose of improvement or for any other manufacturing or commercial requirements.

Air Conditioning
Carisma **CRSO** High Pressure Fan Coil Units



Sabiana s.p.a. • via Piave, 53 • 20011 Corbetta • Milano • Italy • phone +39.02.97203.1 r.a. / +39.02.97270429 / +39.02.97270576
fax +39.02.9777282 / +39.02.9772820 • www.sabiana.it • info@sabiana.it

CRSO - EX - 04/14
Cod. A4690100 C/04/14